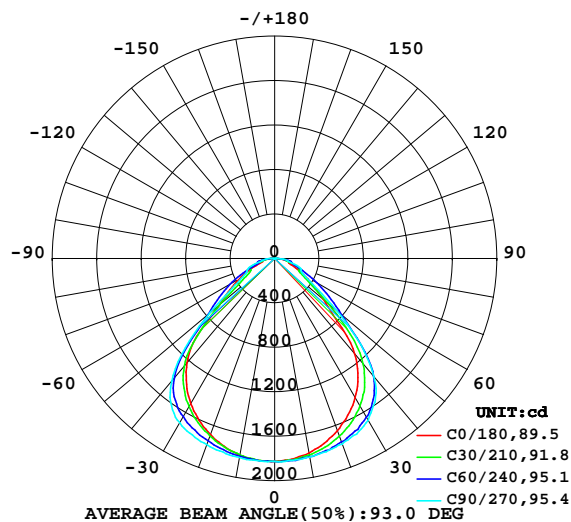
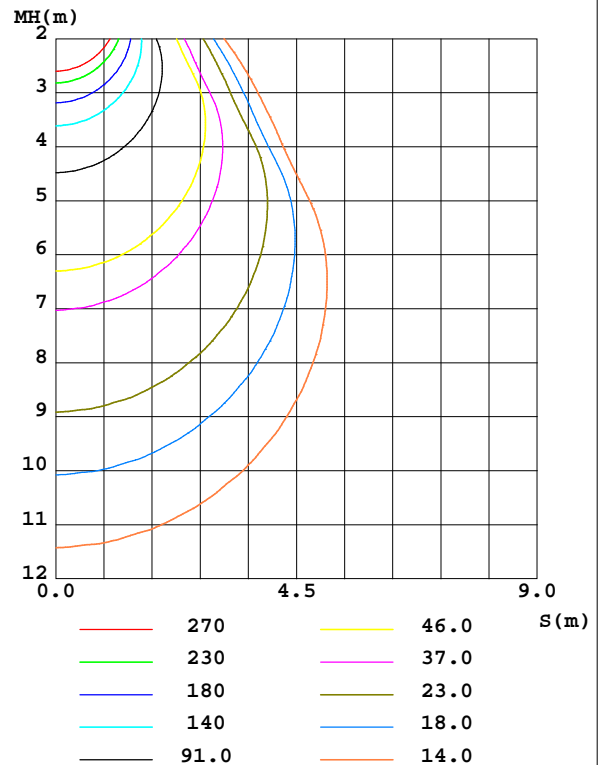


LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:229.43V I:0.1693A P:38.205W PF:0.9837 Freq:50.00Hz Lamp Flux:4074.77x1 lm		
NAME: Verso 1200 38W NW	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: PURATI PTY LTD	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 106.66 lm/W
MODEL		Imax(cd)	1831	S/MH(C0/180)	1.23	
NOMINAL POWER(W)	38	LOR(%)	100.0	S/MH(C90/270)	1.36	
RATED VOLTAGE(V)	230	TOTAL FLUX(lm)	4074.8	η UP,DN(C0-180)	0.3,48.9	
NOMINAL FLUX(lm)	4074.77	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.2,50.6	
LAMPS INSIDE	1	η up(%)	0.5	CIBSE SHR NOM	1.25	
TEST VOLTAGE(V)	229.3	η down(%)	99.5	CIBSE SHR MAX	1.35	

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)


C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:Mr.Ma
Test Date:20 February 2024

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity:65.0%
Test Distance:6.200m [K=1.0000]
Remarks:

ZONAL FLUX DIAGRAM
ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum,lamp
10	1778	1804	1817	1794	1797	1801	1818	1804	0- 10	173.2	173.2	4.25,4.25
20	1650	1730	1777	1701	1687	1724	1782	1724	10- 20	499.4	672.6	16.5,16.5
30	1447	1594	1684	1551	1509	1591	1708	1582	20- 30	765.6	1438	35.3,35.3
40	1123	1313	1392	1269	1227	1334	1440	1320	30- 40	914.8	2353	57.7,57.7
50	572.0	706.2	728.7	646.2	649.6	709.3	755.1	710.6	40- 50	773.9	3127	76.7,76.7
60	308.4	357.7	310.0	330.5	364.1	368.0	329.8	371.6	50- 60	436.0	3563	87.4,87.4
70	149.9	213.9	240.3	190.5	168.7	209.0	248.4	211.3	60- 70	267.8	3831	94,94
80	101.1	123.5	118.2	108.4	116.1	121.6	115.3	128.8	70- 80	160.9	3992	98,98
90	0.5120	0.6036	0.6882	0.5890	1.117	0.7715	1.977	1.138	80- 90	63.03	4055	99.5,99.5
100	0.8103	0.9396	1.129	0.9421	0.8806	1.063	1.175	0.9847	90-100	0.8979	4056	99.5,99.5
110	1.351	1.591	1.941	1.598	1.274	1.648	1.887	1.510	100-110	1.332	4057	99.6,99.6
120	2.467	2.649	2.954	2.656	2.126	2.644	2.834	2.476	110-120	2.043	4059	99.6,99.6
130	3.948	3.922	4.162	3.910	3.442	3.808	3.981	3.667	120-130	2.875	4062	99.7,99.7
140	5.089	5.165	5.399	5.073	4.559	4.928	5.146	4.840	130-140	3.426	4065	99.8,99.8
150	6.280	6.408	6.433	6.082	5.598	5.907	6.212	6.076	140-150	3.484	4069	99.9,99.9
160	7.625	7.527	7.351	7.122	6.935	6.960	7.168	7.285	150-160	3.079	4072	99.9,99.9
170	8.774	8.231	8.017	8.000	8.225	7.873	7.910	8.159	160-170	2.171	4074	100,100
180	9.312	8.569	8.376	8.580	9.314	8.564	8.366	8.580	170-180	0.7941	4075	100,100
DEG	LUMINOUS INTENSITY:cd									UNIT: lm		


Conical surface Flux(90deg): 2786.6 lm
%lum = 68.4%
%lamp = 68.4%
Conical surface Flux(130deg): 3710.8 lm
%lum = 91.1%
%lamp = 91.1%

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:Mr.Ma
Test Date:20 February 2024

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity:65.0%
Test Distance:6.200m [K=1.0000]
Remarks:

LUMINANCE LIMITATION CURVES

Test:U:229.43V I:0.1693A P:38.205W PF:0.9837 Freq:50.00Hz Lamp Flux:4074.77x1 lm		
NAME: Verso 1200 38W NW	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: PURATI PTY LTD	SUR.:	Shielding Angle:

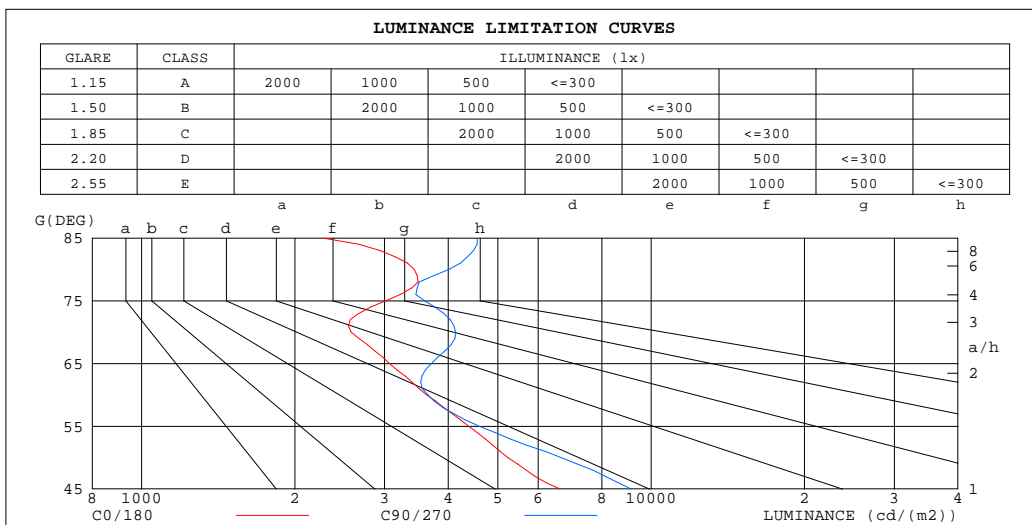

LUMINANCE cd/(m2)		
G(DEG)	C0/180	C90/270
85	2277	4560
80	3428	4007
75	3013	3599
70	2579	4134
65	3070	3704
60	3630	3649
55	4389	4605
50	5238	6671
45	6631	9145


C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature: 25.3°C
Operators: Mr.Ma
Test Date: 20 February 2024

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity: 65.0%
Test Distance: 6.200m [K=1.0000]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:229.43V I:0.1693A P:38.205W PF:0.9837 Freq:50.00Hz Lamp Flux:4074.77x1 lm		
NAME: Verso 1200 38W NW	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: PURATI PTY LTD	SUR.:	Shielding Angle:

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio Coefficients of Utilization(CU)															
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	.00
1.0	1.06	1.02	.99	1.04	1.00	.97	.99	.97	.94	.95	.93	.91	.92	.90	.88	.86
2.0	.94	.88	.83	.92	.87	.82	.89	.84	.80	.86	.82	.79	.83	.80	.77	.75
3.0	.84	.77	.71	.83	.76	.71	.80	.74	.70	.77	.72	.68	.75	.71	.67	.65
4.0	.76	.68	.62	.75	.67	.62	.72	.66	.61	.70	.64	.60	.68	.63	.59	.57
5.0	.69	.61	.55	.68	.60	.54	.65	.59	.54	.64	.58	.53	.62	.57	.52	.51
6.0	.62	.54	.48	.62	.54	.48	.60	.53	.48	.58	.52	.47	.57	.51	.47	.45
7.0	.57	.49	.43	.56	.49	.43	.55	.48	.43	.53	.47	.43	.52	.46	.42	.40
8.0	.52	.44	.39	.52	.44	.39	.50	.44	.39	.49	.43	.38	.48	.42	.38	.36
9.0	.48	.41	.35	.48	.40	.35	.47	.40	.35	.46	.39	.35	.44	.39	.35	.33
10.0	.45	.37	.32	.44	.37	.32	.43	.37	.32	.42	.36	.32	.41	.36	.32	.30

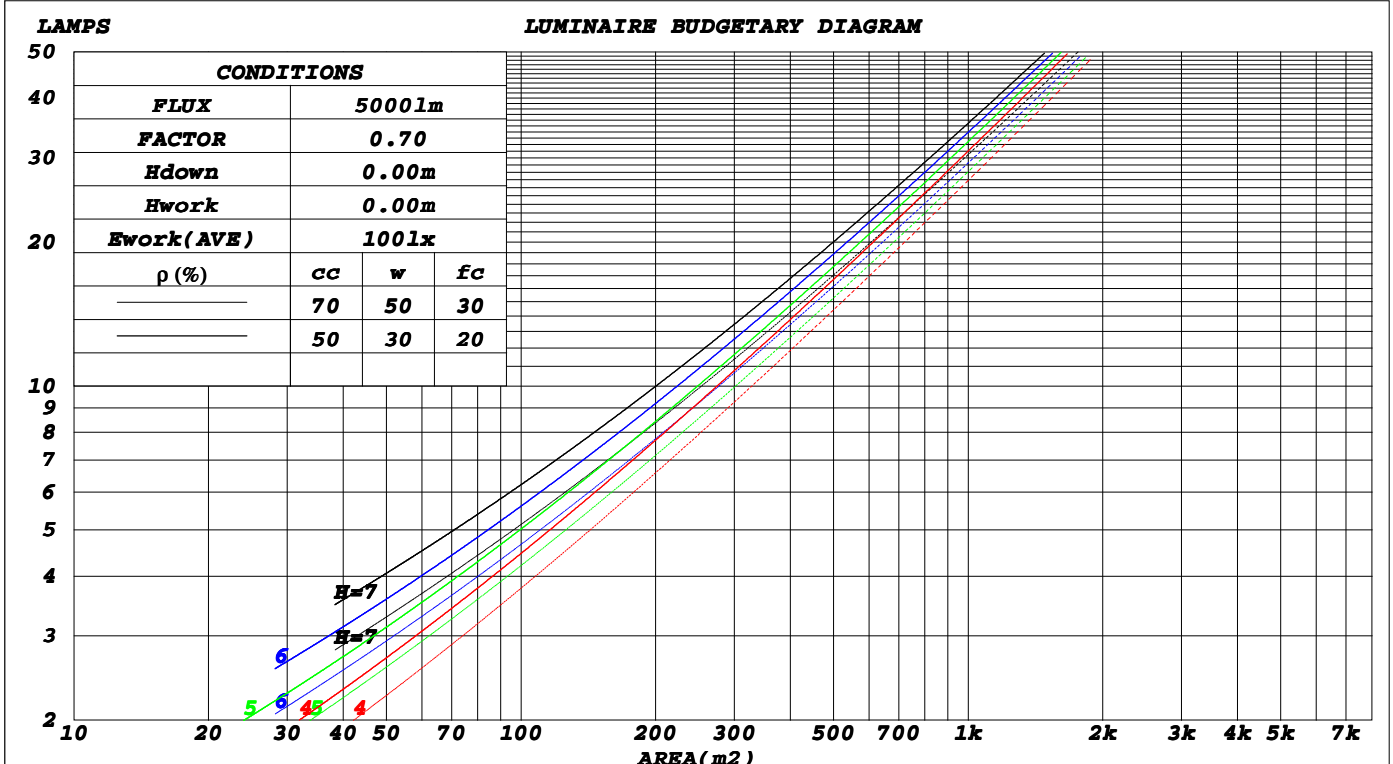

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:Mr.Ma
Test Date:20 February 2024

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 γ Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity:65.0%
Test Distance:6.200m [K=1.0000]
Remarks:

WEC AND CCEC

Test:U:229.43V I:0.1693A P:38.205W PF:0.9837 Freq:50.00Hz Lamp Flux:4074.77x1 lm		
NAME: Verso 1200 38W NW	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: PURATI PTY LTD	SUR.:	Shielding Angle:

ρ_{cc}	80%			70%			50%			30%			10%			0	
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
ρ_{fc}	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)										
0.0																	
1.0	.268	.152	.048	.261	.149	.047	.247	.142	.045	.235	.136	.043	.224	.130	.042		
2.0	.253	.139	.043	.247	.136	.042	.235	.131	.041	.225	.126	.039	.215	.121	.038		
3.0	.237	.126	.038	.231	.124	.037	.221	.120	.036	.212	.116	.036	.203	.112	.035		
4.0	.221	.115	.034	.216	.113	.033	.207	.110	.033	.199	.107	.032	.191	.104	.032		
5.0	.207	.105	.031	.203	.104	.030	.195	.101	.030	.187	.099	.029	.180	.096	.029		
6.0	.194	.097	.028	.190	.096	.028	.183	.094	.027	.176	.092	.027	.170	.090	.027		
7.0	.182	.090	.026	.179	.089	.025	.172	.087	.025	.167	.085	.025	.161	.084	.025		
8.0	.172	.084	.024	.169	.083	.023	.163	.081	.023	.157	.080	.023	.152	.078	.023		
9.0	.162	.078	.022	.159	.078	.022	.154	.076	.022	.149	.075	.021	.145	.074	.021		
10.0	.153	.073	.020	.151	.073	.020	.146	.072	.020	.142	.070	.020	.138	.069	.020		

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio Ceiling Cavity Exitance Coefficients(CCEC)															
0.0	.194	.194	.194	.166	.166	.166	.113	.113	.113	.065	.065	.065	.021	.021	.021	
1.0	.181	.160	.141	.155	.138	.122	.106	.095	.084	.061	.055	.049	.020	.018	.016	
2.0	.171	.136	.107	.146	.117	.092	.100	.081	.064	.058	.047	.038	.019	.015	.012	
3.0	.162	.118	.083	.139	.102	.072	.095	.071	.050	.055	.041	.030	.018	.013	.010	
4.0	.154	.104	.066	.132	.090	.058	.091	.063	.041	.053	.037	.024	.017	.012	.008	
5.0	.146	.094	.055	.126	.081	.047	.087	.057	.033	.050	.033	.020	.016	.011	.007	
6.0	.139	.085	.046	.120	.074	.040	.083	.052	.028	.048	.030	.017	.015	.010	.006	
7.0	.133	.078	.039	.114	.068	.034	.079	.047	.024	.046	.028	.014	.015	.009	.005	
8.0	.127	.072	.034	.109	.063	.030	.076	.044	.021	.044	.026	.013	.014	.008	.004	
9.0	.121	.067	.031	.105	.058	.027	.072	.041	.019	.042	.024	.011	.014	.008	.004	
10.0	.116	.063	.027	.100	.055	.024	.070	.038	.017	.041	.023	.010	.013	.007	.003	

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:Mr.Ma
Test Date:20 February 2024
 γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity:65.0%
Test Distance:6.200m [K=1.0000]
Remarks:

UGR(Unified Glare Rating) Table

Test:U:229.43V I:0.1693A P:38.205W PF:0.9837 Freq:50.00Hz Lamp Flux:4074.77x1 lm										
NAME: Verso 1200 38W NW					TYPE:			WEIGHT:		
SPEC.:					DIM.:			SERIAL No.:		
MFR.: PURATI PTY LTD					SUR.:			Shielding Angle:		
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	12.2	13.6	12.5	13.8	14.0	13.6	14.9	13.8	15.1	15.3
3H	12.9	14.2	13.2	14.4	14.6	14.3	15.6	14.6	15.8	16.1
4H	13.3	14.5	13.6	14.7	15.0	14.7	15.9	15.0	16.1	16.4
6H	13.8	14.9	14.1	15.2	15.4	15.1	16.2	15.4	16.5	16.8
8H	13.9	15.0	14.3	15.3	15.6	15.3	16.4	15.7	16.7	17.0
12H	14.0	15.0	14.4	15.3	15.6	15.5	16.5	15.8	16.8	17.1
4H 2H	12.6	13.8	12.9	14.1	14.3	13.7	14.9	14.0	15.2	15.4
3H	13.6	14.7	14.0	15.0	15.3	14.7	15.8	15.1	16.0	16.4
4H	14.2	15.1	14.5	15.4	15.7	15.3	16.2	15.6	16.5	16.9
6H	14.8	15.6	15.2	15.9	16.3	15.9	16.7	16.3	17.1	17.4
8H	15.0	15.8	15.4	16.1	16.5	16.2	17.0	16.6	17.3	17.7
12H	15.1	15.8	15.6	16.2	16.6	16.5	17.2	16.9	17.6	18.0
8H 4H	14.4	15.2	14.8	15.6	16.0	15.5	16.2	15.9	16.6	17.0
6H	15.2	15.9	15.7	16.3	16.7	16.3	17.0	16.8	17.4	17.8
8H	15.6	16.2	16.1	16.6	17.1	16.8	17.4	17.3	17.8	18.2
12H	15.8	16.3	16.3	16.8	17.3	17.2	17.7	17.7	18.1	18.6
12H 4H	14.5	15.2	14.9	15.6	16.0	15.5	16.2	15.9	16.6	17.0
6H	15.4	16.0	15.9	16.4	16.8	16.4	17.0	16.9	17.4	17.9
8H	15.8	16.3	16.3	16.8	17.3	16.9	17.4	17.4	17.9	18.4
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 0.6 / - 0.6					+ 0.5 / - 0.5				
1.5H	+ 0.4 / - 0.6					+ 0.3 / - 0.5				
2.0H	+ 1.0 / - 0.6					+ 1.1 / - 1.0				

CIE Pub.117, 4075 lm Total Lamp Luminous Flux Correct ($8\log(F/F_0) = 4.9$)
Area: 0.17 m²

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:Mr.Ma
Test Date:20 February 2024

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity:65.0%
Test Distance:6.200m [K=1.0000]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:229.43V I:0.1693A P:38.205W PF:0.9837 Freq:50.00Hz Lamp Flux:4074.77x1 lm		
NAME: Verso 1200 38W NW	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: PURATI PTY LTD	SUR.:	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	65	55	49	65	55	49	63	54	49	43
0.80	75	65	59	74	65	59	72	64	58	52
1.00	83	73	67	82	73	67	80	74	66	60
1.25	89	80	74	88	80	74	85	78	73	67
1.50	94	85	80	92	85	79	89	83	78	71
2.00	99	92	87	98	91	86	94	89	84	77
2.50	102	96	91	100	95	90	97	92	88	80
3.00	105	99	95	103	98	94	99	95	91	83
4.00	108	104	100	106	102	98	102	98	95	87
5.00	110	106	103	108	104	101	103	101	98	89
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Mr.Ma
Test Date:20 February 2024

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity:65.0%
Test Distance:6.200m [K=1.0000]
Remarks:

ISOCANDELA DIAGRAM

Test:U:229.43V I:0.1693A P:38.205W PF:0.9837 Freq:50.00Hz Lamp Flux:4074.77x1 lm		
NAME: Verso 1200 38W NW	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: PURATI PTY LTD	SUR.:	Shielding Angle:

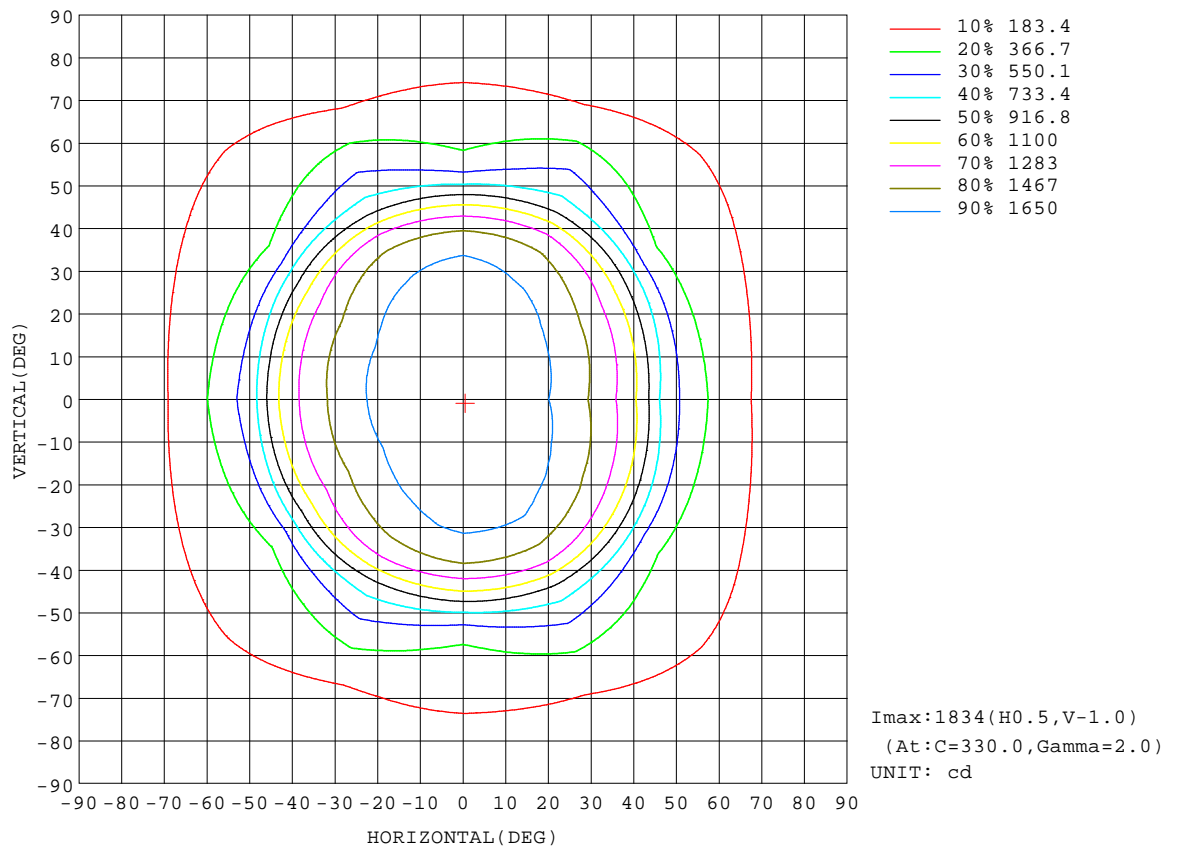


C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:Mr.Ma
Test Date:20 February 2024

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity:65.0%
Test Distance:6.200m [K=1.0000]
Remarks:

AAI Figure

Test:U:229.43V I:0.1693A P:38.205W PF:0.9837 Freq:50.00Hz Lamp Flux:4074.77x1 lm		
NAME: Verso 1200 38W NW	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: PURATI PTY LTD	SUR.:	Shielding Angle:

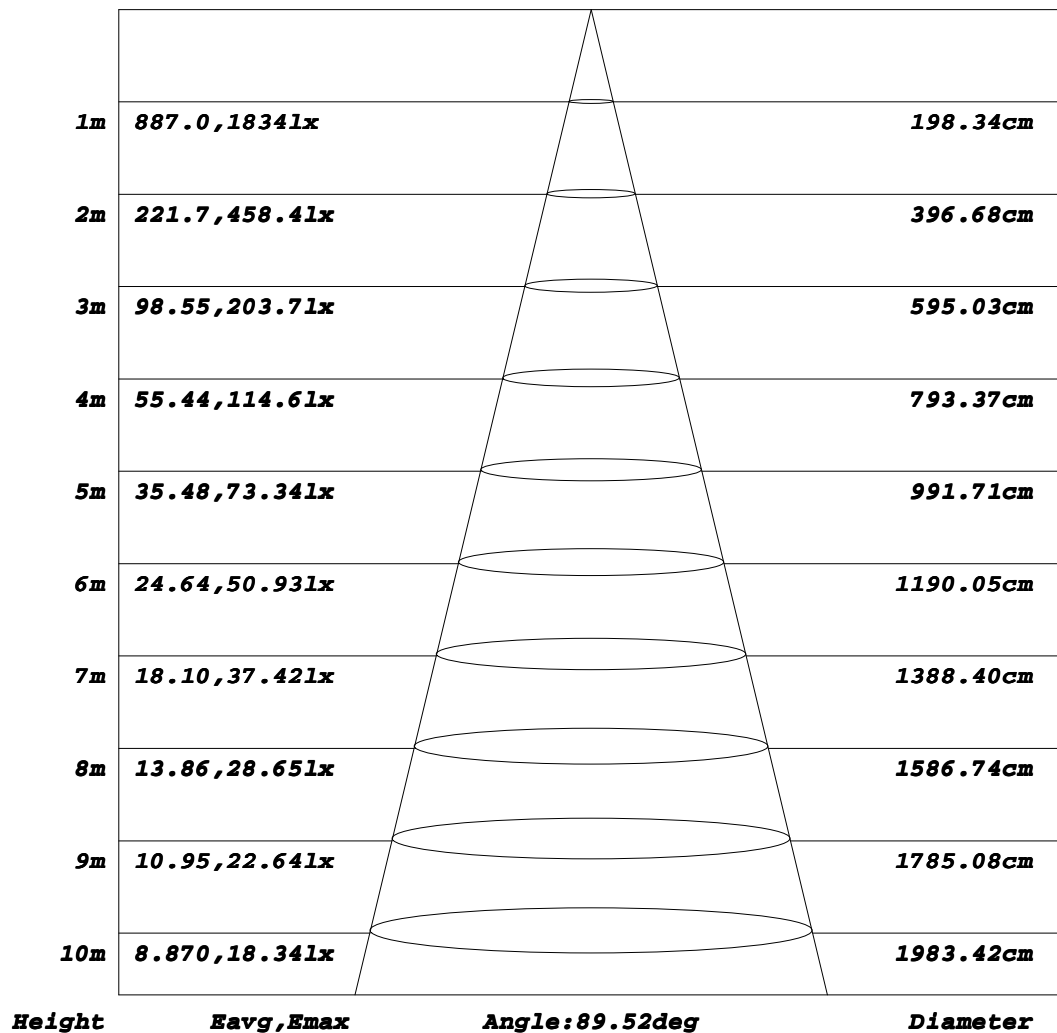Flux out:2787 lm


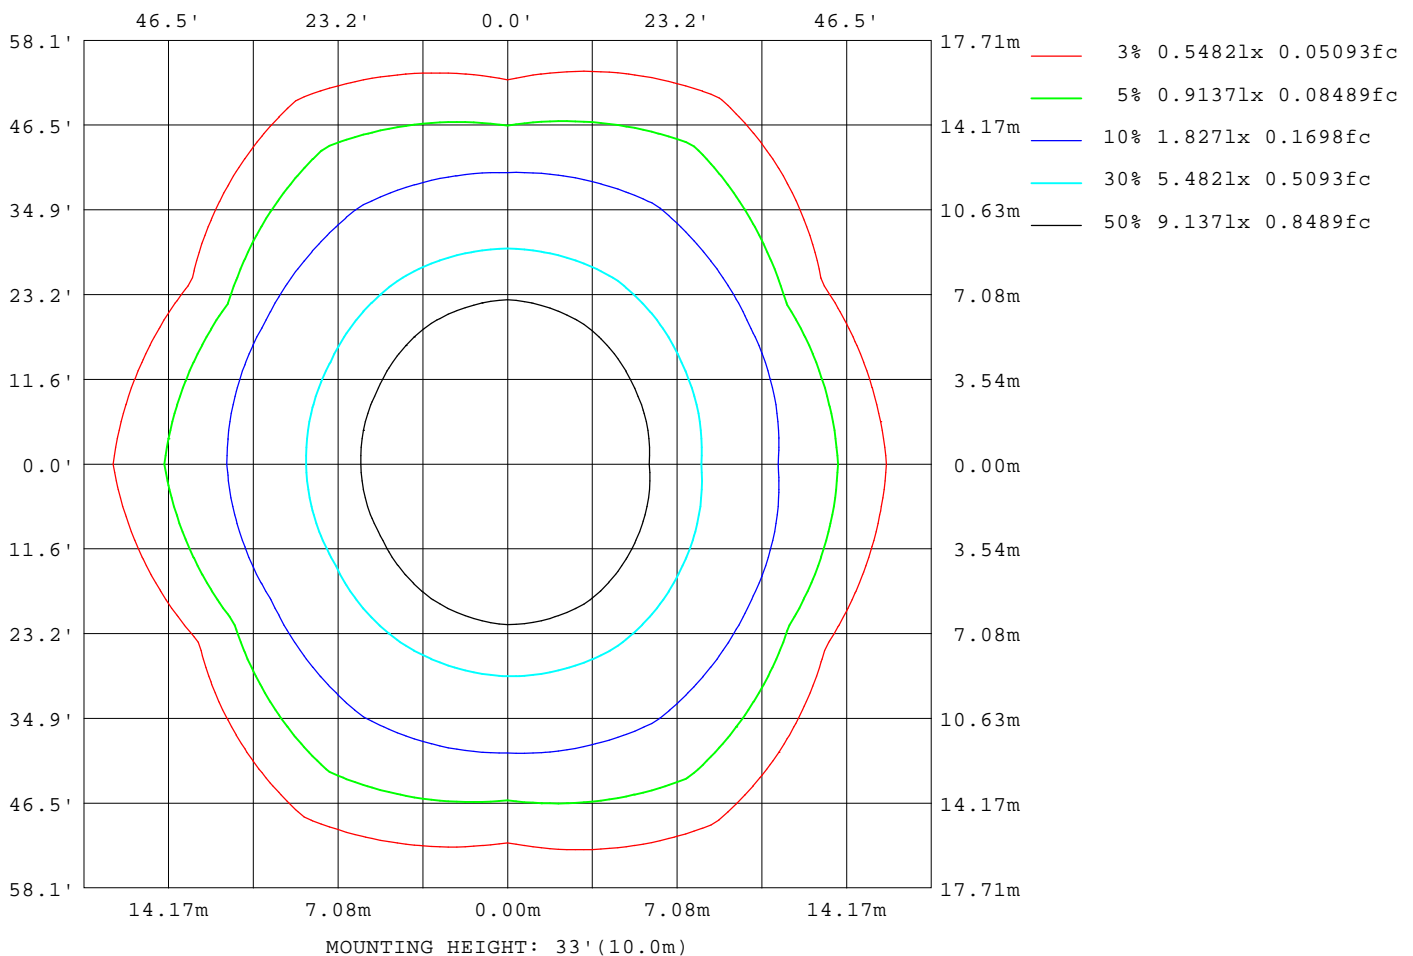
Note: The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature: 25.3°C
Operators: Mr.Ma
Test Date: 20 February 2024

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity: 65.0%
Test Distance: 6.200m [K=1.0000]
Remarks:

ISOLUX DIAGRAM

Test:U:229.43V I:0.1693A P:38.205W PF:0.9837 Freq:50.00Hz Lamp Flux:4074.77x1 lm		
NAME: Verso 1200 38W NW	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: PURATI PTY LTD	SUR.:	Shielding Angle:



C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature: 25.3°C
Operators: Mr.Ma
Test Date: 20 February 2024

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity: 65.0%
Test Distance: 6.200m [K=1.0000]
Remarks:

LED Avg.L Report

Test:U:229.43V I:0.1693A P:38.205W PF:0.9837 Freq:50.00Hz Lamp Flux:4074.77x1 lm		
NAME: Verso 1200 38W NW	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: PURATI PTY LTD	SUR.:	Shielding Angle:


AvgL	cd/m2
L_0~180(65)av	3355
L_0~180(75)av	2865
L_0~180(85)av	3001
L_90~270(65)av	3754
L_90~270(75)av	3692
L_90~270(85)av	4928
L_45(65)av	3846
L_45(75)av	3363
L_45(85)av	4025

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Mr.Ma
Test Date:20 February 2024

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity:65.0%
Test Distance:6.200m [K=1.0000]
Remarks:

Planar Illuminance Curve

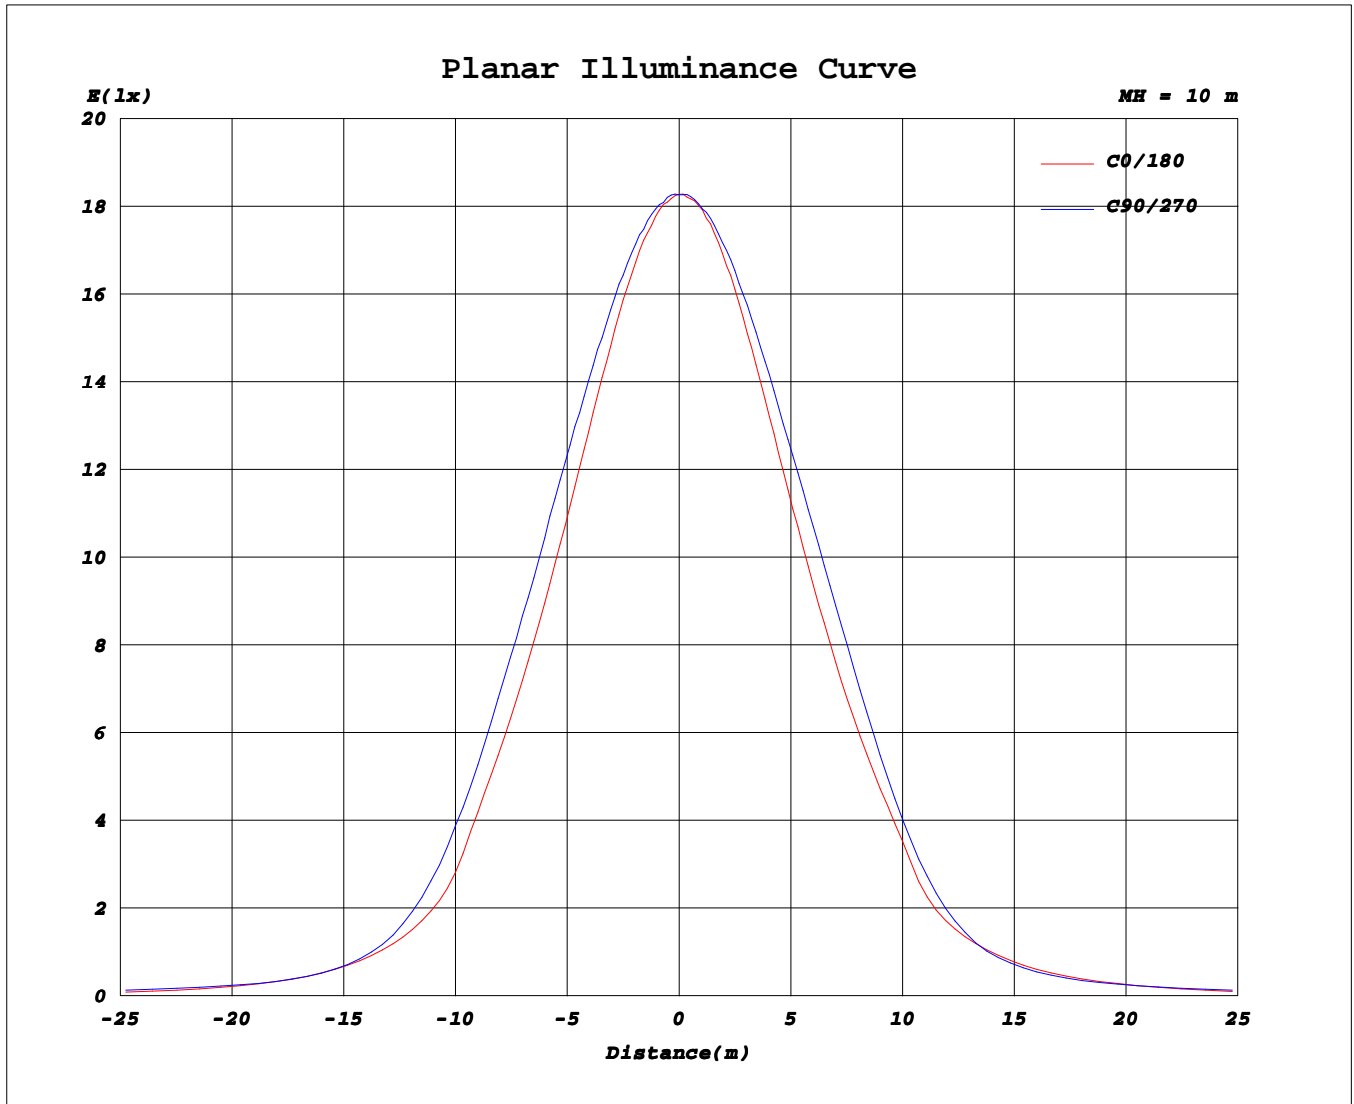

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature: 25.3°C
Operators: Mr.Ma
Test Date: 20 February 2024

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity: 65.0%
Test Distance: 6.200m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:229.43V I:0.1693A P:38.205W PF:0.9837 Freq:50.00Hz Lamp Flux:4074.77x1 lm																	
NAME: Verso 1200 38W NW									TYPE:						WEIGHT:		
SPEC.:									DIM.:						SERIAL No.:		
MFR.: PURATI PTY LTD									SUR.:						Shielding Angle:		

Table--1

UNIT: cd

C(DEG) γ (DEG)	0	30	60	90	120	150	180	210	240	270	300	330						
0	1826	1826	1826	1826	1826	1826	1826	1826	1826	1826	1826	1826						
5	1812	1819	1823	1824	1818	1816	1822	1820	1821	1826	1824	1822						
10	1778	1796	1811	1817	1799	1790	1797	1796	1806	1818	1813	1796						
15	1723	1757	1790	1800	1768	1742	1751	1757	1780	1802	1787	1756						
20	1650	1702	1757	1777	1723	1680	1687	1701	1746	1782	1750	1698						
25	1559	1630	1713	1744	1669	1600	1607	1631	1702	1751	1703	1620						
30	1447	1536	1651	1684	1599	1502	1509	1540	1642	1708	1639	1524						
35	1308	1413	1546	1576	1494	1370	1383	1424	1559	1618	1551	1399						
40	1123	1240	1386	1392	1333	1205	1227	1266	1403	1440	1406	1233						
45	797	963	1102	1099	1022	913	997	984	1106	1138	1126	949						
50	572	624	789	729	738	554	650	639	780	755	801	620						
55	428	386	597	449	563	345	491	377	609	464	625	373						
60	308	276	439	310	412	248	364	272	464	330	476	266						
65	220	239	307	266	292	228	262	239	317	273	335	235						
70	150	220	208	240	179	202	169	220	198	248	212	211						
75	132	145	161	158	148	125	120	144	158	167	158	143						
80	101	105	142	118	121	96.0	116	99.6	144	115	155	103						
85	33.7	56.7	68.9	67.5	49.3	46.2	55.2	51.3	67.8	78.5	77.5	58.5						
90	0.51	0.52	0.68	0.69	0.65	0.53	1.12	0.74	0.81	1.98	1.53	0.75						
95	0.65	0.67	0.84	0.87	0.82	0.67	0.76	0.82	0.96	0.97	0.88	0.78						
100	0.81	0.82	1.06	1.13	1.06	0.83	0.88	0.95	1.18	1.17	1.07	0.90						
105	1.04	1.05	1.39	1.51	1.39	1.06	1.04	1.14	1.47	1.49	1.32	1.08						
110	1.35	1.38	1.80	1.94	1.83	1.37	1.27	1.44	1.85	1.89	1.69	1.33						
115	1.82	1.88	2.26	2.42	2.32	1.84	1.61	1.90	2.30	2.33	2.13	1.74						
120	2.47	2.53	2.77	2.95	2.84	2.47	2.13	2.49	2.80	2.83	2.63	2.32						
125	3.20	3.23	3.33	3.54	3.40	3.15	2.76	3.12	3.32	3.40	3.12	2.98						
130	3.95	3.91	3.94	4.16	3.99	3.83	3.44	3.73	3.88	3.98	3.66	3.67						
135	4.55	4.52	4.57	4.78	4.60	4.42	4.06	4.31	4.45	4.57	4.24	4.26						
140	5.09	5.12	5.21	5.40	5.16	4.99	4.56	4.85	5.00	5.15	4.85	4.83						
145	5.65	5.75	5.82	5.93	5.69	5.49	5.05	5.34	5.50	5.70	5.48	5.41						
150	6.28	6.45	6.37	6.43	6.19	5.98	5.60	5.82	5.99	6.21	6.10	6.05						
155	6.95	7.14	6.87	6.91	6.67	6.52	6.23	6.35	6.51	6.71	6.65	6.76						
160	7.62	7.72	7.33	7.35	7.17	7.07	6.93	6.89	7.03	7.17	7.14	7.43						
165	8.24	8.12	7.71	7.70	7.59	7.61	7.60	7.41	7.48	7.55	7.55	8.03						
170	8.77	8.42	8.05	8.02	7.96	8.04	8.22	7.89	7.86	7.91	7.93	8.39						
175	9.21	8.66	8.30	8.26	8.23	8.42	8.66	8.25	8.13	8.14	8.19	8.58						
180	9.31	8.71	8.43	8.38	8.43	8.73	9.31	8.71	8.42	8.37	8.45	8.71						

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Mr.Ma
Test Date:20 February 2024
γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity:65.0%
Test Distance:6.200m [K=1.0000]
Remarks: