


LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:229.47V I:0.1308A P:29.503W PF:0.9828 Freq:50.00Hz Lamp Flux:3062.96x1 lm		
NAME: Verso 1200 30W WW	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: PURATI PTY LTD	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 103.82 lm/W
MODEL		Imax(cd)	1379	S/MH(C0/180)		1.25
NOMINAL POWER(W)	30	LOR(%)	100.0	S/MH(C90/270)		1.36
RATED VOLTAGE(V)	230	TOTAL FLUX(lm)	3063.0	η UP,DN(C0-180)		0.3,48.4
NOMINAL FLUX(lm)	3062.96	CIE CLASS	DIRECT	η UP,DN(C180-360)		0.2,51.1
LAMPS INSIDE	1	η up(%)	0.5	CIBSE SHR NOM		1.25
TEST VOLTAGE(V)	229.3	η down(%)	99.5	CIBSE SHR MAX		1.35

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

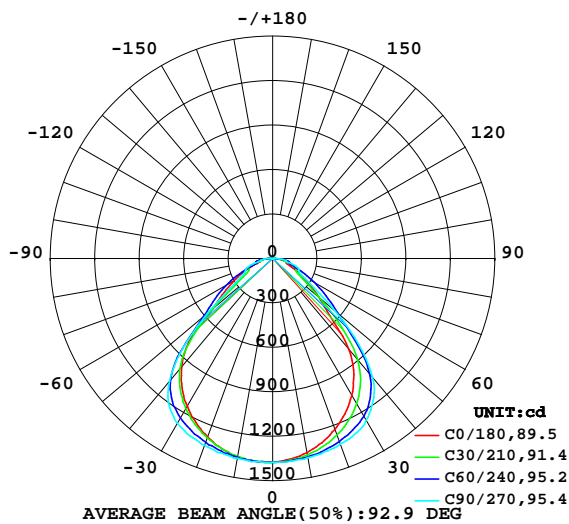

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

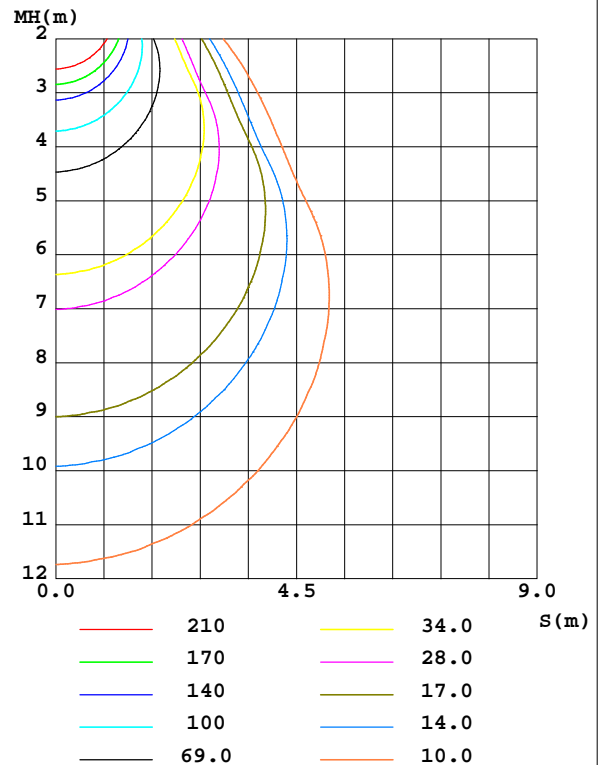

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Mr.Ma
Test Date:20 February 2024

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity:65.0%
Test Distance:6.200m [K=1.0000]
Remarks:

ZONAL FLUX DIAGRAM
ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum,lamp
10	1331	1354	1365	1354	1359	1360	1370	1356	0- 10	130.3	130.3	4.25,4.25
20	1229	1292	1333	1287	1282	1305	1342	1295	10- 20	375.7	506.1	16.5,16.5
30	1069	1182	1261	1177	1152	1207	1284	1186	20- 30	575.7	1082	35.3,35.3
40	801.5	957.5	1050	975.2	955.0	1023	1083	979.0	30- 40	687.4	1769	57.8,57.8
50	405.9	491.1	549.2	515.1	529.4	567.2	572.0	512.9	40- 50	583.0	2352	76.8,76.8
60	214.7	258.9	229.2	260.5	301.0	285.5	246.3	274.3	50- 60	329.4	2681	87.5,87.5
70	102.5	150.8	178.9	146.0	138.3	159.6	185.6	151.7	60- 70	200.1	2882	94.1,94.1
80	64.85	88.84	87.83	84.42	90.95	92.94	82.60	93.97	70- 80	118.3	3000	97.9,97.9
90	0.4036	0.4555	0.5170	0.4434	7.705	1.106	1.645	0.5709	80- 90	47.83	3048	99.5,99.5
100	0.6446	0.7306	0.8643	0.7001	0.6387	0.7625	0.8936	0.7607	90-100	0.7203	3048	99.5,99.5
110	1.086	1.239	1.476	1.183	0.9071	1.181	1.442	1.183	100-110	1.007	3049	99.6,99.6
120	1.985	2.066	2.252	1.967	1.493	1.905	2.160	1.930	110-120	1.546	3051	99.6,99.6
130	3.096	3.037	3.164	2.907	2.457	2.796	3.034	2.833	120-130	2.175	3053	99.7,99.7
140	3.919	3.981	4.058	3.789	3.337	3.640	3.907	3.727	130-140	2.589	3056	99.8,99.8
150	4.853	4.908	4.869	4.554	4.150	4.397	4.710	4.655	140-150	2.636	3058	99.9,99.9
160	5.780	5.734	5.545	5.338	5.177	5.206	5.422	5.537	150-160	2.325	3061	99.9,99.9
170	6.617	6.261	6.068	6.014	6.210	5.915	5.957	6.133	160-170	1.638	3062	100,100
180	7.070	6.481	6.320	6.446	7.076	6.479	6.318	6.437	170-180	0.5990	3063	100,100
DEG	LUMINOUS INTENSITY:cd									UNIT: lm		

Conical surface Flux(90deg): 2094.5 lm

%lum = 68.4%

%lamp = 68.4%

Conical surface Flux(130deg): 2792.4 lm

%lum = 91.2%

%lamp = 91.2%

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Mr.Ma
Test Date:20 February 2024

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity:65.0%
Test Distance:6.200m [K=1.0000]
Remarks:

LUMINANCE LIMITATION CURVES

Test:U:229.47V I:0.1308A P:29.503W PF:0.9828 Freq:50.00Hz
Lamp Flux:3062.96x1 lm

NAME: Verso 1200 30W WW

TYPE:

WEIGHT:

SPEC.:

DIM.:

SERIAL No.:


MFR.: PURATI PTY LTD

SUR.:

Shielding Angle:

LUMINANCE LIMITATION CURVES

GLARE	CLASS	ILLUMINANCE (lx)							
1.15	A	2000	1000	500	<=300				
1.50	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.20	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300

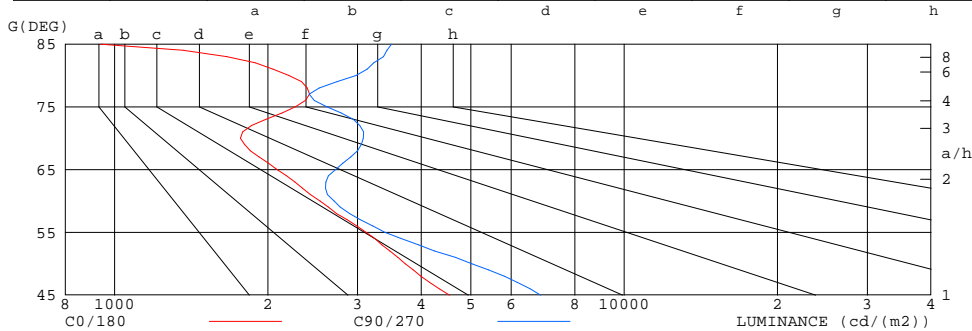

LUMINANCE cd/(m2)

G(DEG)	C0/180	C90/270
85	939	3493
80	2200	2975
75	2261	2612
70	1766	3076
65	2085	2713
60	2530	2696
55	3118	3393
50	3720	5025
45	4538	6853


C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature: 25.3°C
Operators: Mr. Ma
Test Date: 20 February 2024

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity: 65.0%
Test Distance: 6.200m [K=1.0000]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:229.47V I:0.1308A P:29.503W PF:0.9828 Freq:50.00Hz Lamp Flux:3062.96x1 lm		
NAME: Verso 1200 30W WW	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: PURATI PTY LTD	SUR.:	Shielding Angle:

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio Coefficients of Utilization(CU)															
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	.00
1.0	1.06	1.02	.99	1.04	1.00	.97	.99	.97	.94	.95	.93	.91	.92	.90	.88	.86
2.0	.94	.88	.83	.92	.87	.82	.89	.84	.80	.86	.82	.79	.83	.80	.77	.75
3.0	.84	.77	.71	.83	.76	.71	.80	.74	.70	.77	.72	.68	.75	.71	.67	.65
4.0	.76	.68	.62	.75	.67	.62	.72	.66	.61	.70	.64	.60	.68	.63	.59	.57
5.0	.69	.61	.55	.68	.60	.54	.66	.59	.54	.64	.58	.53	.62	.57	.53	.51
6.0	.62	.54	.48	.62	.54	.48	.60	.53	.48	.58	.52	.47	.57	.51	.47	.45
7.0	.57	.49	.43	.56	.49	.43	.55	.48	.43	.53	.47	.43	.52	.46	.42	.40
8.0	.52	.45	.39	.52	.44	.39	.50	.44	.39	.49	.43	.38	.48	.42	.38	.36
9.0	.48	.41	.35	.48	.40	.35	.47	.40	.35	.46	.39	.35	.45	.39	.35	.33
10.0	.45	.37	.32	.44	.37	.32	.43	.37	.32	.42	.36	.32	.41	.36	.32	.30

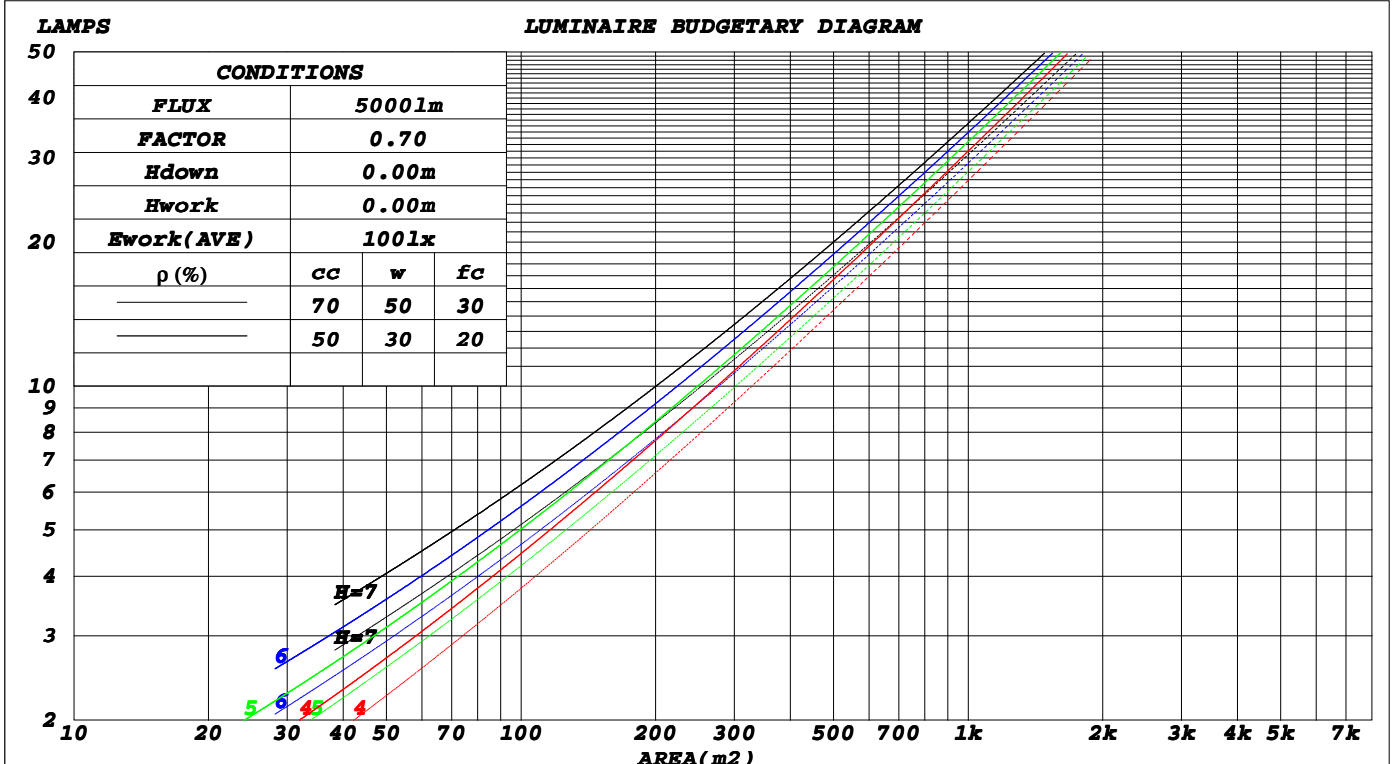

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:Mr.Ma
Test Date:20 February 2024

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 γ Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity:65.0%
Test Distance:6.200m [K=1.0000]
Remarks:

WEC AND CCEC

Test:U:229.47V I:0.1308A P:29.503W PF:0.9828 Freq:50.00Hz Lamp Flux:3062.96x1 lm		
NAME: Verso 1200 30W WW	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: PURATI PTY LTD	SUR.:	Shielding Angle:

ρ_{cc}	80%			70%			50%			30%			10%			0														
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0														
ρ_{fc}	20%			20%			20%			20%			20%			0														
RCR	RCR:Room Cavity Ratio															Wall Exitance Coefficients(WEC)														
0.0																														
1.0	.267	.152	.048	.260	.148	.047	.247	.142	.045	.235	.135	.043	.223	.129	.042															
2.0	.253	.139	.043	.247	.136	.042	.235	.131	.041	.224	.126	.039	.214	.121	.038															
3.0	.237	.126	.038	.231	.124	.037	.221	.120	.036	.212	.116	.036	.203	.112	.035															
4.0	.221	.115	.034	.216	.113	.033	.207	.110	.033	.199	.107	.032	.191	.104	.032															
5.0	.207	.105	.031	.203	.104	.030	.195	.101	.030	.187	.099	.029	.180	.096	.029															
6.0	.194	.097	.028	.190	.096	.028	.183	.094	.027	.176	.092	.027	.170	.090	.027															
7.0	.182	.090	.026	.179	.089	.025	.172	.087	.025	.166	.085	.025	.161	.084	.025															
8.0	.172	.084	.024	.169	.083	.023	.163	.081	.023	.157	.080	.023	.152	.078	.023															
9.0	.162	.078	.022	.159	.078	.022	.154	.076	.022	.149	.075	.021	.145	.073	.021															
10.0	.153	.073	.020	.151	.073	.020	.146	.072	.020	.142	.070	.020	.138	.069	.020															

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio Ceiling Cavity Exitance Coefficients(CCEC)															
0.0	.194	.194	.194	.166	.166	.166	.113	.113	.113	.065	.065	.065	.021	.021	.021	
1.0	.181	.160	.142	.155	.138	.122	.106	.095	.084	.061	.055	.049	.020	.018	.016	
2.0	.171	.136	.107	.146	.117	.092	.100	.081	.064	.058	.047	.038	.019	.015	.012	
3.0	.162	.118	.083	.139	.102	.072	.095	.071	.050	.055	.041	.030	.018	.013	.010	
4.0	.154	.104	.066	.132	.090	.058	.091	.063	.041	.053	.037	.024	.017	.012	.008	
5.0	.146	.094	.055	.126	.081	.047	.087	.057	.034	.050	.033	.020	.016	.011	.007	
6.0	.139	.085	.046	.120	.074	.040	.083	.052	.028	.048	.030	.017	.015	.010	.006	
7.0	.133	.078	.039	.114	.068	.034	.079	.047	.024	.046	.028	.014	.015	.009	.005	
8.0	.127	.072	.034	.109	.063	.030	.076	.044	.021	.044	.026	.013	.014	.008	.004	
9.0	.121	.067	.031	.105	.058	.027	.072	.041	.019	.042	.024	.011	.014	.008	.004	
10.0	.116	.063	.027	.100	.055	.024	.070	.038	.017	.041	.023	.010	.013	.007	.003	

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:Mr.Ma
Test Date:20 February 2024
 γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity:65.0%
Test Distance:6.200m [K=1.0000]
Remarks:

UGR(Unified Glare Rating) Table

Test:U:229.47V I:0.1308A P:29.503W PF:0.9828 Freq:50.00Hz Lamp Flux:3062.96x1 lm										
NAME: Verso 1200 30W WW					TYPE:			WEIGHT:		
SPEC.:					DIM.:			SERIAL No.:		
MFR.: PURATI PTY LTD					SUR.:			Shielding Angle:		
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	11.8	13.1	12.0	13.3	13.5	13.4	14.8	13.7	15.0	15.2
3H	12.4	13.7	12.7	13.9	14.2	14.2	15.4	14.5	15.7	15.9
4H	12.8	14.0	13.1	14.3	14.5	14.6	15.7	14.9	16.0	16.2
6H	13.3	14.4	13.6	14.7	14.9	14.9	16.0	15.3	16.3	16.6
8H	13.4	14.5	13.7	14.7	15.0	15.2	16.2	15.5	16.5	16.8
12H	13.4	14.4	13.8	14.7	15.0	15.3	16.4	15.7	16.7	17.0
4H 2H	12.2	13.4	12.5	13.6	13.9	13.6	14.7	13.9	15.0	15.3
3H	13.2	14.2	13.5	14.5	14.8	14.5	15.6	14.9	15.9	16.2
4H	13.7	14.6	14.1	14.9	15.3	15.1	16.0	15.4	16.3	16.7
6H	14.3	15.1	14.7	15.4	15.8	15.7	16.5	16.1	16.9	17.2
8H	14.5	15.2	14.9	15.6	16.0	16.0	16.8	16.4	17.2	17.5
12H	14.5	15.2	14.9	15.6	16.0	16.3	17.0	16.7	17.4	17.8
8H 4H	14.0	14.7	14.4	15.1	15.5	15.3	16.0	15.7	16.4	16.8
6H	14.8	15.4	15.2	15.8	16.2	16.1	16.8	16.6	17.2	17.6
8H	15.1	15.6	15.5	16.0	16.5	16.6	17.2	17.1	17.6	18.0
12H	15.2	15.7	15.7	16.1	16.6	17.0	17.5	17.5	17.9	18.4
12H 4H	14.0	14.7	14.5	15.1	15.5	15.3	16.0	15.7	16.4	16.8
6H	14.9	15.5	15.4	15.9	16.4	16.2	16.8	16.7	17.2	17.7
8H	15.3	15.7	15.7	16.2	16.7	16.7	17.2	17.2	17.7	18.1
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 0.6 / - 0.6					+ 0.5 / - 0.5				
1.5H	+ 0.5 / - 0.7					+ 0.3 / - 0.5				
2.0H	+ 1.0 / - 0.5					+ 1.1 / - 1.0				

CIE Pub.117, 3063 lm Total Lamp Luminous Flux Correct ($8\log(F/F_0) = 3.9$)
Area: 0.17 m²

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:Mr.Ma
Test Date:20 February 2024

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity:65.0%
Test Distance:6.200m [K=1.0000]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:229.47V I:0.1308A P:29.503W PF:0.9828 Freq:50.00Hz Lamp Flux:3062.96x1 lm		
NAME: Verso 1200 30W WW	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: PURATI PTY LTD	SUR.:	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	65	55	49	65	55	49	63	54	49	43
0.80	75	65	59	74	65	59	72	64	58	52
1.00	83	73	67	82	73	67	80	74	66	60
1.25	89	80	74	88	80	74	85	78	73	67
1.50	94	85	80	92	85	79	89	83	78	71
2.00	99	92	87	98	91	86	94	89	85	77
2.50	102	96	91	100	95	90	97	92	88	80
3.00	105	99	95	103	98	94	99	95	91	84
4.00	108	104	100	106	102	98	102	98	96	87
5.00	110	106	103	108	104	101	104	101	98	89
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Mr.Ma
Test Date:20 February 2024

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity:65.0%
Test Distance:6.200m [K=1.0000]
Remarks:

ISOCANDELA DIAGRAM

Test:U:229.47V I:0.1308A P:29.503W PF:0.9828 Freq:50.00Hz Lamp Flux:3062.96x1 lm		
NAME: Verso 1200 30W WW	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: PURATI PTY LTD	SUR.:	Shielding Angle:

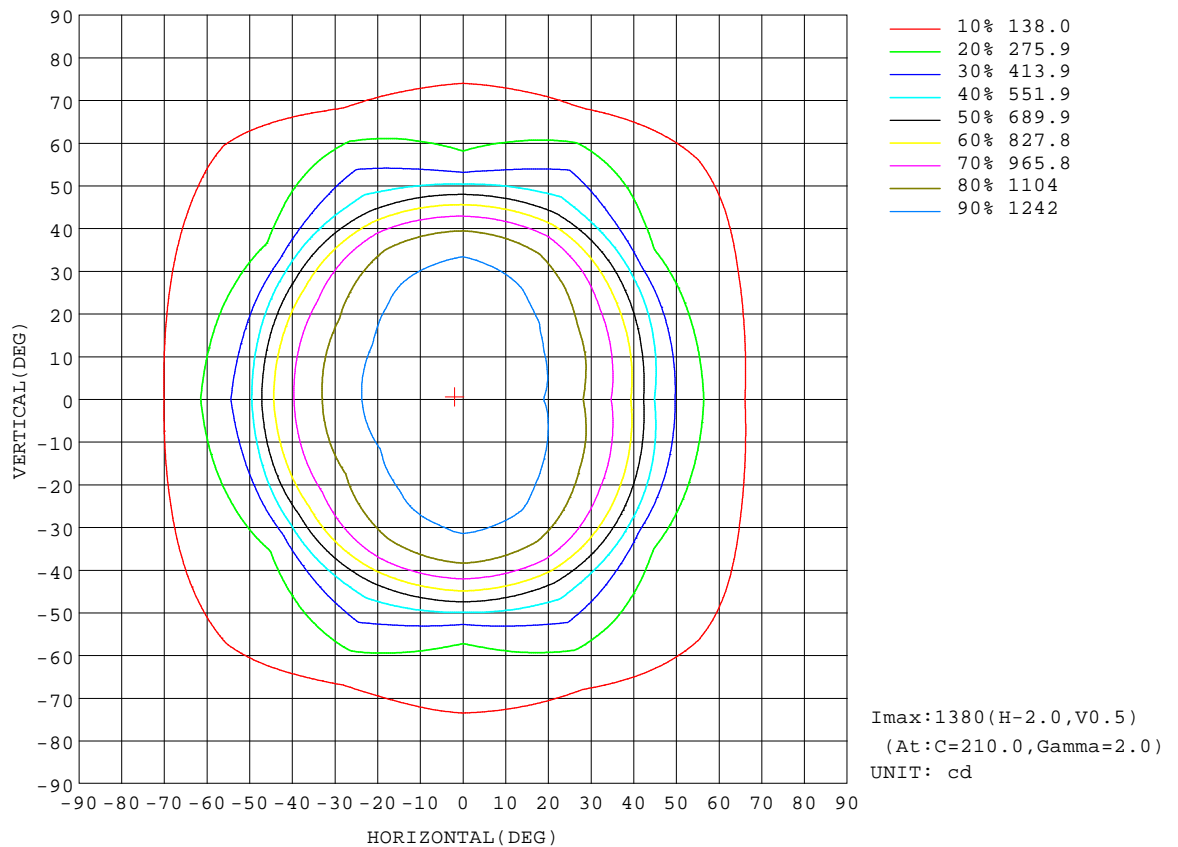


C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:Mr.Ma
Test Date:20 February 2024

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity:65.0%
Test Distance:6.200m [K=1.0000]
Remarks:

AAI Figure

Test:U:229.47V I:0.1308A P:29.503W PF:0.9828 Freq:50.00Hz Lamp Flux:3062.96x1 lm		
NAME: Verso 1200 30W WW	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: PURATI PTY LTD	SUR.:	Shielding Angle:

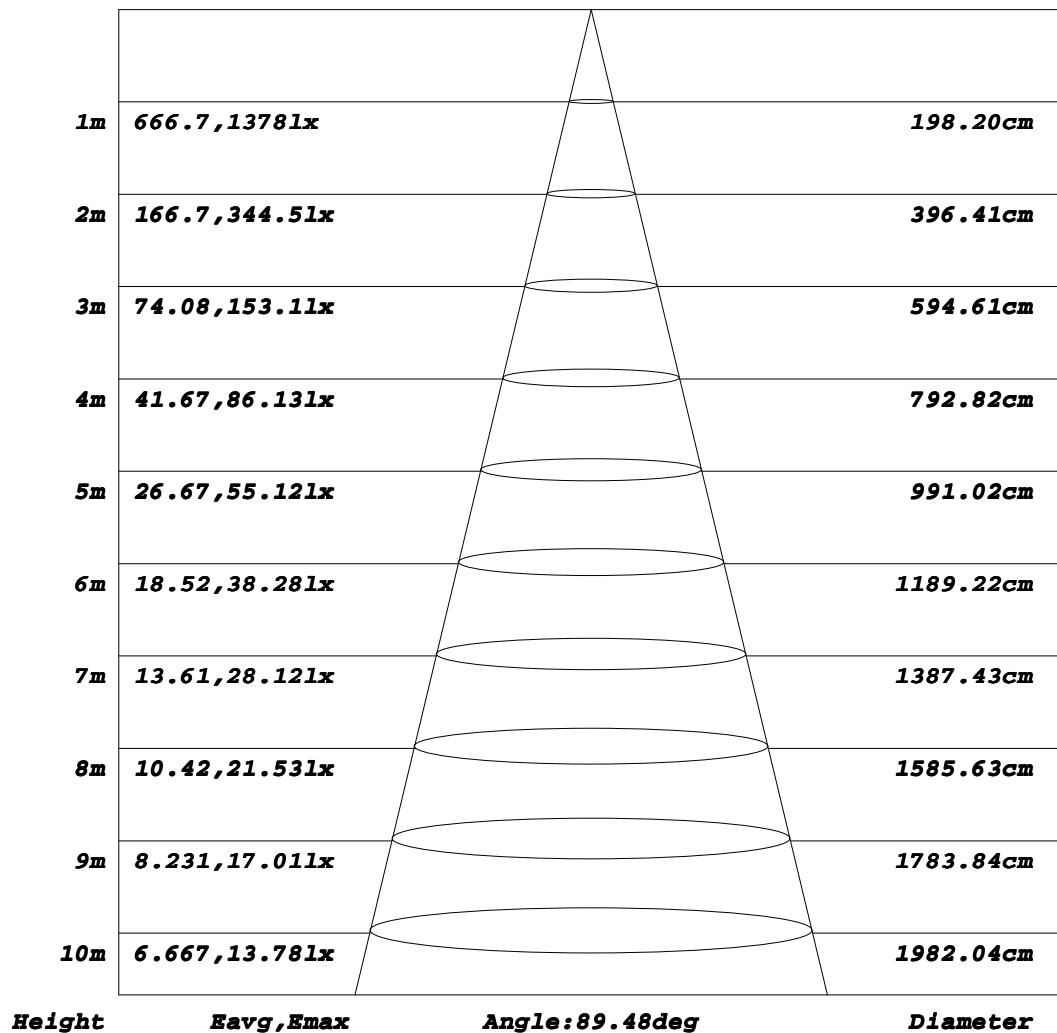Flux out:2095 lm


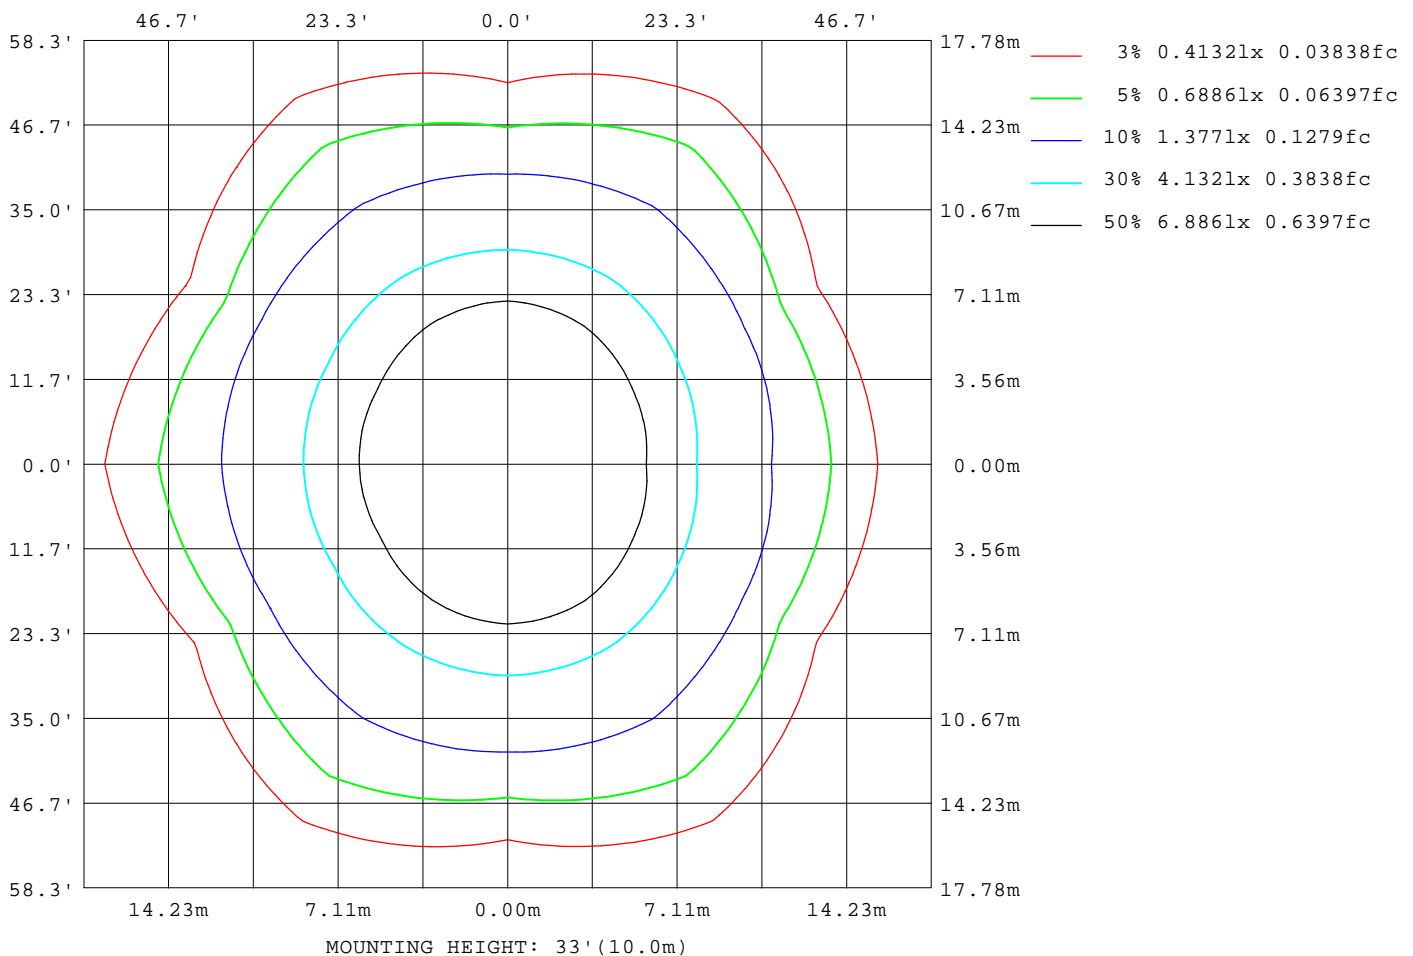
Note: The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature: 25.3°C
Operators: Mr.Ma
Test Date: 20 February 2024

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity: 65.0%
Test Distance: 6.200m [K=1.0000]
Remarks:

ISOLUX DIAGRAM

Test:U:229.47V I:0.1308A P:29.503W PF:0.9828 Freq:50.00Hz Lamp Flux:3062.96x1 lm		
NAME: Verso 1200 30W WW	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: PURATI PTY LTD	SUR.:	Shielding Angle:



C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature: 25.3°C
Operators: Mr.Ma
Test Date: 20 February 2024

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity: 65.0%
Test Distance: 6.200m [K=1.0000]
Remarks:

LED Avg.L Report

Test:U:229.47V I:0.1308A P:29.503W PF:0.9828 Freq:50.00Hz Lamp Flux:3062.96x1 lm		
NAME: Verso 1200 30W WW	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: PURATI PTY LTD	SUR.:	Shielding Angle:


AvgL	cd/m2
L_0~180(65)av	2547
L_0~180(75)av	2139
L_0~180(85)av	2290
L_90~270(65)av	2772
L_90~270(75)av	2696
L_90~270(85)av	3723
L_45(65)av	2864
L_45(75)av	2446
L_45(85)av	3031

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Mr.Ma
Test Date:20 February 2024

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity:65.0%
Test Distance:6.200m [K=1.0000]
Remarks:

Planar Illuminance Curve

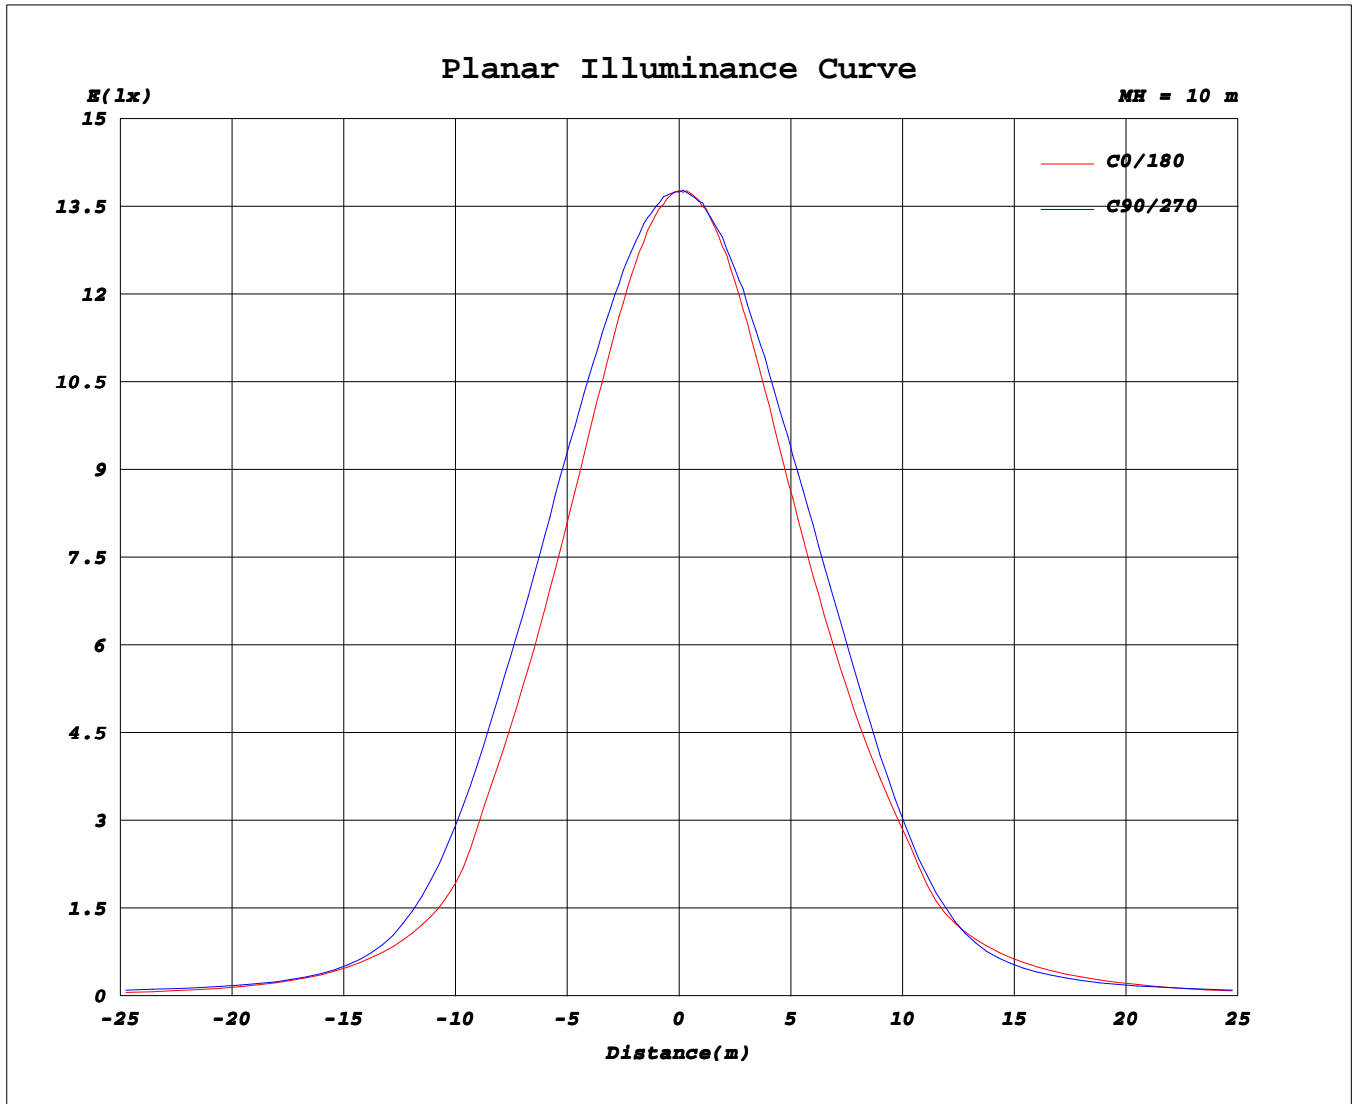

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature: 25.3°C
Operators: Mr.Ma
Test Date: 20 February 2024

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity: 65.0%
Test Distance: 6.200m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:229.47V I:0.1308A P:29.503W PF:0.9828 Freq:50.00Hz Lamp Flux:3062.96x1 lm																		
NAME: Verso 1200 30W WW									TYPE:					WEIGHT:				
SPEC.:									DIM.:					SERIAL No.:				
MFR.: PURATI PTY LTD									SUR.:					Shielding Angle:				

Table--1

UNIT: cd

C(DEG) γ (DEG)	0	30	60	90	120	150	180	210	240	270	300	330						
0	1375	1375	1375	1375	1375	1375	1375	1375	1375	1375	1375	1375						
5	1360	1367	1371	1372	1371	1369	1374	1373	1373	1375	1373	1368						
10	1331	1347	1360	1365	1357	1351	1359	1357	1363	1370	1363	1349						
15	1287	1313	1341	1351	1333	1318	1328	1329	1345	1358	1346	1318						
20	1229	1268	1315	1333	1301	1272	1282	1289	1320	1342	1318	1272						
25	1157	1209	1279	1308	1262	1216	1224	1237	1287	1319	1282	1215						
30	1069	1133	1230	1261	1209	1144	1152	1170	1243	1284	1233	1139						
35	958	1033	1149	1179	1137	1054	1065	1086	1178	1216	1164	1041						
40	801	895	1020	1050	1014	937	955	974	1072	1083	1050	908						
45	545	665	793	824	789	729	804	785	863	858	833	683						
50	406	406	576	549	571	459	529	527	608	572	595	431						
55	304	261	441	331	439	276	399	300	472	348	467	267						
60	215	191	327	229	327	194	301	208	363	246	354	194						
65	150	175	223	195	224	170	216	175	247	203	243	175						
70	103	156	145	179	135	158	138	168	151	186	150	153						
75	99.3	94.5	118	115	107	98.6	88.9	117	112	122	114	98.8						
80	64.8	75.1	103	87.8	95.9	72.9	90.9	75.5	110	82.6	113	75.0						
85	13.9	32.5	45.6	51.8	41.7	42.9	54.0	46.3	56.1	58.6	55.9	38.1						
90	0.40	0.41	0.50	0.52	0.49	0.40	7.71	1.42	0.80	1.64	0.61	0.53						
95	0.51	0.52	0.64	0.66	0.62	0.49	0.55	0.59	0.71	0.73	0.68	0.60						
100	0.64	0.64	0.82	0.86	0.79	0.61	0.64	0.67	0.85	0.89	0.83	0.69						
105	0.83	0.82	1.07	1.15	1.04	0.77	0.74	0.80	1.07	1.13	1.03	0.84						
110	1.09	1.09	1.39	1.48	1.37	1.00	0.91	1.00	1.36	1.44	1.31	1.05						
115	1.47	1.49	1.75	1.84	1.74	1.35	1.13	1.32	1.69	1.78	1.65	1.38						
120	1.98	1.99	2.14	2.25	2.13	1.81	1.49	1.75	2.06	2.16	2.02	1.84						
125	2.55	2.54	2.58	2.69	2.55	2.31	1.96	2.22	2.46	2.58	2.40	2.35						
130	3.10	3.04	3.03	3.16	2.99	2.83	2.46	2.71	2.88	3.03	2.81	2.85						
135	3.52	3.51	3.51	3.63	3.44	3.28	2.95	3.14	3.32	3.48	3.26	3.30						
140	3.92	3.96	4.00	4.06	3.87	3.71	3.34	3.55	3.73	3.91	3.73	3.72						
145	4.34	4.43	4.46	4.49	4.27	4.10	3.74	3.93	4.12	4.33	4.21	4.17						
150	4.85	4.95	4.86	4.87	4.64	4.46	4.15	4.30	4.50	4.71	4.65	4.66						
155	5.30	5.46	5.23	5.21	5.01	4.88	4.62	4.71	4.89	5.07	5.03	5.18						
160	5.78	5.89	5.57	5.55	5.39	5.29	5.18	5.14	5.28	5.42	5.41	5.67						
165	6.23	6.22	5.85	5.83	5.72	5.71	5.72	5.55	5.62	5.71	5.70	6.04						
170	6.62	6.42	6.10	6.07	5.98	6.04	6.21	5.92	5.91	5.96	5.96	6.30						
175	6.93	6.56	6.28	6.23	6.20	6.32	6.56	6.21	6.14	6.14	6.18	6.43						
180	7.07	6.60	6.36	6.32	6.33	6.57	7.08	6.59	6.37	6.32	6.32	6.55						

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Mr.Ma
Test Date:20 February 2024
γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity:65.0%
Test Distance:6.200m [K=1.0000]
Remarks: