


LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:229.68V I:0.1291A P:29.134W PF:0.9827 Freq:50.00Hz Lamp Flux:3154.17x1 lm		
NAME: Verso 1200 30W NW	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: PURATI PTY LTD	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 108.27 lm/W
MODEL		Imax(cd)	1421	S/MH(C0/180)		1.21
NOMINAL POWER(W)	30	LOR(%)	100.0	S/MH(C90/270)		1.37
RATED VOLTAGE(V)	230	TOTAL FLUX(lm)	3154.2	η UP,DN(C0-180)		0.2,49.1
NOMINAL FLUX(lm)	3154.17	CIE CLASS	DIRECT	η UP,DN(C180-360)		0.2,50.4
LAMPS INSIDE	1	η up(%)	0.5	CIBSE SHR NOM		1.25
TEST VOLTAGE(V)	229.3	η down(%)	99.5	CIBSE SHR MAX		1.35

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

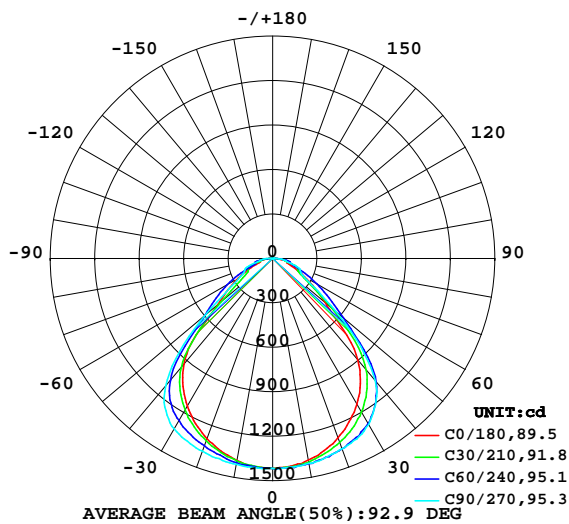

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

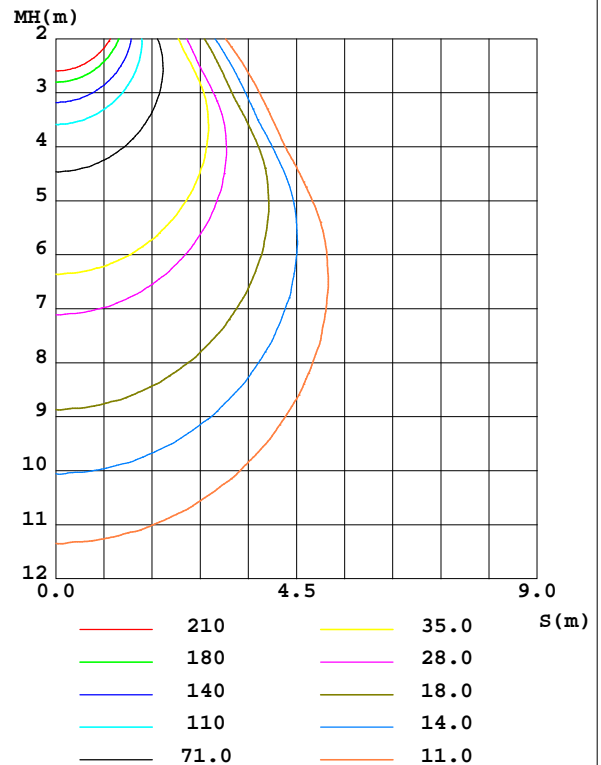

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Mr.Ma
Test Date:20 February 2024

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity:65.0%
Test Distance:6.200m [K=1.0000]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	1383	1402	1404	1386	1384	1394	1409	1401	0- 10	134.2	134.2	4.26,4.26
20	1288	1345	1368	1313	1295	1328	1383	1337	10- 20	386.5	520.7	16.5,16.5
30	1137	1243	1295	1192	1152	1223	1328	1228	20- 30	592.1	1113	35.3,35.3
40	894.2	1035	1079	968.2	931.6	1017	1123	1030	30- 40	707.7	1821	57.7,57.7
50	462.2	571.1	558.4	487.1	484.0	524.8	593.2	559.8	40- 50	599.3	2420	76.7,76.7
60	250.6	284.9	240.7	248.9	271.0	278.5	257.6	295.0	50- 60	337.6	2758	87.4,87.4
70	122.8	170.6	186.5	144.2	120.8	157.0	193.5	168.5	60- 70	207.5	2965	94,94
80	85.06	97.86	91.99	80.11	85.22	91.12	89.35	100.6	70- 80	124.5	3090	98,98
90	0.3837	0.5076	0.5342	0.4564	0.5338	0.6001	2.470	3.963	80- 90	49.04	3139	99.5,99.5
100	0.6099	0.7162	0.8797	0.7401	0.6949	0.8359	0.9026	0.7434	90-100	0.7262	3139	99.5,99.5
110	1.001	1.201	1.515	1.257	1.013	1.311	1.447	1.134	100-110	1.028	3140	99.6,99.6
120	1.832	2.005	2.300	2.081	1.716	2.097	2.183	1.879	110-120	1.579	3142	99.6,99.6
130	2.973	2.988	3.230	3.053	2.741	3.005	3.068	2.804	120-130	2.226	3144	99.7,99.7
140	3.887	3.952	4.139	3.949	3.583	3.858	3.958	3.712	130-140	2.649	3147	99.8,99.8
150	4.780	4.910	4.976	4.719	4.400	4.614	4.787	4.662	140-150	2.693	3149	99.9,99.9
160	5.853	5.798	5.682	5.516	5.422	5.412	5.531	5.610	150-160	2.379	3152	99.9,99.9
170	6.767	6.348	6.199	6.188	6.397	6.107	6.116	6.294	160-170	1.679	3154	100,100
180	7.213	6.624	6.485	6.630	7.215	6.628	6.472	6.618	170-180	0.6140	3154	100,100
DEG	LUMINOUS INTENSITY:cd									UNIT: lm		

Conical surface Flux(90deg): 2156.4 lm

%lum = 68.4%

%lamp = 68.4%

Conical surface Flux(130deg): 2872.2 lm

%lum = 91.1%


%lamp = 91.1%

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:Mr.Ma
Test Date:20 February 2024

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity:65.0%
Test Distance:6.200m [K=1.0000]
Remarks:

LUMINANCE LIMITATION CURVES

Test:U:229.68V I:0.1291A P:29.134W PF:0.9827 Freq:50.00Hz Lamp Flux:3154.17x1 lm		
NAME: Verso 1200 30W NW	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: PURATI PTY LTD	SUR.:	Shielding Angle:

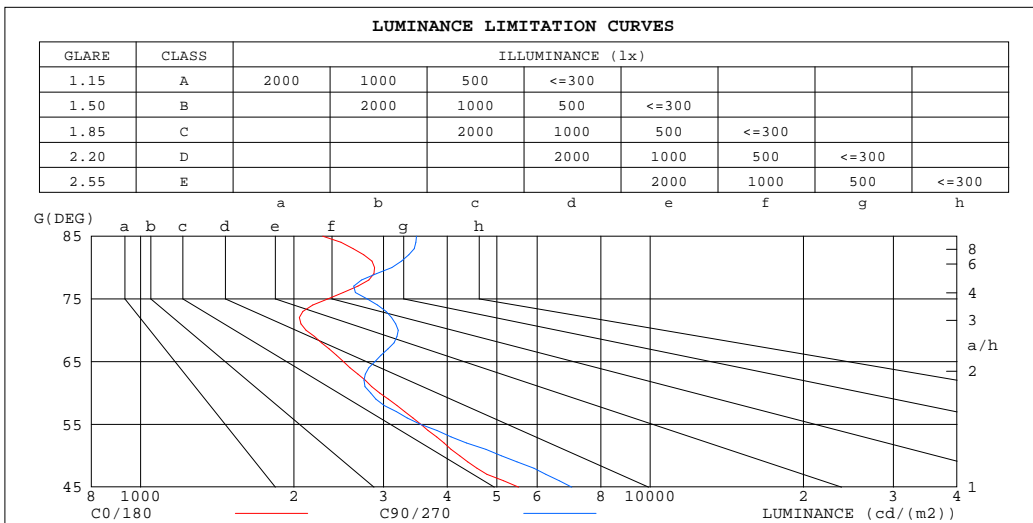

LUMINANCE cd/(m2)		
G(DEG)	C0/180	C90/270
85	2278	3482
80	2880	3114
75	2329	2787
70	2111	3206
65	2504	2884
60	2947	2829
55	3551	3544
50	4228	5106
45	5520	7017


C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:Mr.Ma
Test Date:20 February 2024

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity:65.0%
Test Distance:6.200m [K=1.0000]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:229.68V I:0.1291A P:29.134W PF:0.9827 Freq:50.00Hz Lamp Flux:3154.17x1 lm		
NAME: Verso 1200 30W NW	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: PURATI PTY LTD	SUR.:	Shielding Angle:

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio Coefficients of Utilization(CU)															
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	.00
1.0	1.06	1.02	.99	1.04	1.00	.97	.99	.97	.94	.95	.93	.91	.92	.90	.88	.86
2.0	.94	.88	.83	.92	.87	.82	.89	.84	.80	.86	.82	.79	.83	.80	.77	.75
3.0	.84	.77	.71	.83	.76	.71	.80	.74	.70	.77	.72	.68	.75	.71	.67	.65
4.0	.76	.68	.62	.75	.67	.62	.72	.66	.61	.70	.64	.60	.68	.63	.59	.57
5.0	.69	.61	.55	.68	.60	.54	.65	.59	.54	.64	.58	.53	.62	.57	.52	.51
6.0	.62	.54	.48	.62	.54	.48	.60	.53	.48	.58	.52	.47	.57	.51	.47	.45
7.0	.57	.49	.43	.56	.49	.43	.55	.48	.43	.53	.47	.43	.52	.46	.42	.40
8.0	.52	.44	.39	.52	.44	.39	.50	.44	.39	.49	.43	.38	.48	.42	.38	.36
9.0	.48	.41	.35	.48	.40	.35	.47	.40	.35	.46	.39	.35	.44	.39	.35	.33
10.0	.45	.37	.32	.44	.37	.32	.43	.37	.32	.42	.36	.32	.41	.36	.32	.30

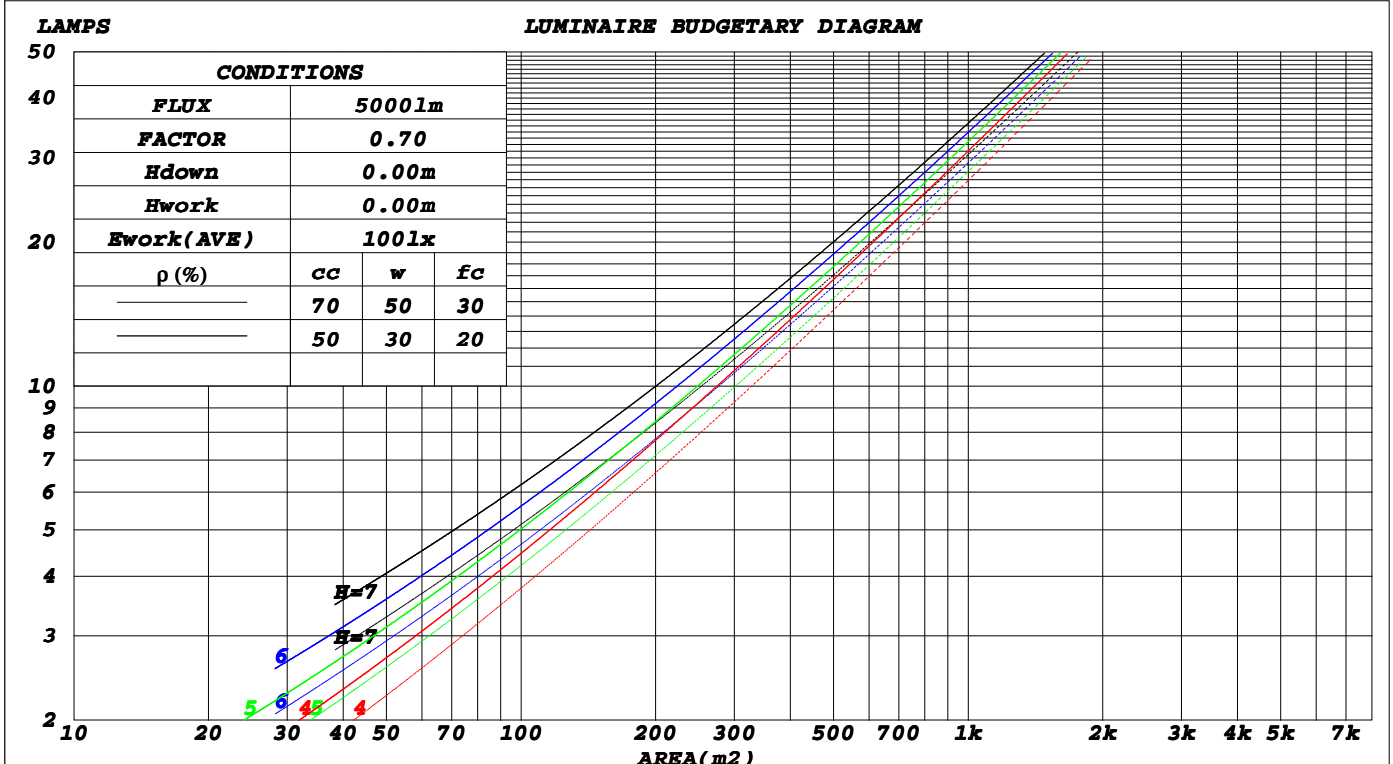

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:Mr.Ma
Test Date:20 February 2024

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 γ Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity:65.0%
Test Distance:6.200m [K=1.0000]
Remarks:

WEC AND CCEC

Test:U:229.68V I:0.1291A P:29.134W PF:0.9827 Freq:50.00Hz Lamp Flux:3154.17x1 lm		
NAME: Verso 1200 30W NW	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: PURATI PTY LTD	SUR.:	Shielding Angle:

ρ_{cc}	80%			70%			50%			30%			10%			0														
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0														
ρ_{fc}	20%			20%			20%			20%			20%			0														
RCR	RCR:Room Cavity Ratio															Wall Exitance Coefficients(WEC)														
0.0																														
1.0	.268	.152	.048	.261	.149	.047	.247	.142	.045	.235	.136	.044	.224	.130	.042															
2.0	.253	.139	.043	.247	.136	.042	.235	.131	.041	.225	.126	.039	.215	.121	.038															
3.0	.237	.126	.038	.231	.124	.037	.221	.120	.036	.212	.116	.036	.203	.112	.035															
4.0	.221	.115	.034	.217	.113	.033	.208	.110	.033	.199	.107	.032	.191	.104	.032															
5.0	.207	.105	.031	.203	.104	.030	.195	.101	.030	.187	.099	.029	.180	.096	.029															
6.0	.194	.097	.028	.190	.096	.028	.183	.094	.027	.176	.092	.027	.170	.090	.027															
7.0	.182	.090	.026	.179	.089	.025	.172	.087	.025	.167	.085	.025	.161	.084	.025															
8.0	.172	.084	.024	.169	.083	.023	.163	.081	.023	.158	.080	.023	.152	.078	.023															
9.0	.162	.078	.022	.159	.078	.022	.154	.076	.022	.149	.075	.021	.145	.074	.021															
10.0	.153	.073	.020	.151	.073	.020	.146	.072	.020	.142	.070	.020	.138	.069	.020															

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio Ceiling Cavity Exitance Coefficients(CCEC)															
0.0	.194	.194	.194	.166	.166	.166	.113	.113	.113	.065	.065	.065	.021	.021	.021	
1.0	.181	.160	.141	.155	.138	.122	.106	.095	.084	.061	.055	.049	.020	.018	.016	
2.0	.171	.136	.106	.146	.117	.092	.100	.081	.064	.058	.047	.038	.019	.015	.012	
3.0	.162	.118	.083	.139	.102	.072	.095	.071	.050	.055	.041	.030	.018	.013	.010	
4.0	.154	.104	.066	.132	.090	.058	.091	.063	.041	.053	.037	.024	.017	.012	.008	
5.0	.146	.094	.055	.126	.081	.047	.087	.057	.033	.050	.033	.020	.016	.011	.007	
6.0	.139	.085	.046	.120	.074	.040	.083	.052	.028	.048	.030	.017	.015	.010	.006	
7.0	.133	.078	.039	.114	.068	.034	.079	.047	.024	.046	.028	.014	.015	.009	.005	
8.0	.127	.072	.034	.109	.063	.030	.076	.044	.021	.044	.026	.013	.014	.008	.004	
9.0	.121	.067	.031	.105	.058	.027	.072	.041	.019	.042	.024	.011	.014	.008	.004	
10.0	.116	.063	.027	.100	.055	.024	.070	.038	.017	.041	.023	.010	.013	.007	.003	

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:Mr.Ma
Test Date:20 February 2024
 γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity:65.0%
Test Distance:6.200m [K=1.0000]
Remarks:

UGR(Unified Glare Rating) Table

Test:U:229.68V I:0.1291A P:29.134W PF:0.9827 Freq:50.00Hz Lamp Flux:3154.17x1 lm										
NAME: Verso 1200 30W NW					TYPE:			WEIGHT:		
SPEC.:					DIM.:			SERIAL No.:		
MFR.: PURATI PTY LTD					SUR.:			Shielding Angle:		
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	12.5	13.9	12.8	14.1	14.3	13.6	15.0	13.9	15.2	15.4
3H	13.2	14.4	13.5	14.7	14.9	14.4	15.7	14.7	15.9	16.1
4H	13.6	14.7	13.9	15.0	15.2	14.8	16.0	15.1	16.2	16.5
6H	14.0	15.1	14.4	15.4	15.7	15.2	16.3	15.5	16.5	16.8
8H	14.2	15.3	14.6	15.6	15.9	15.4	16.4	15.7	16.7	17.0
12H	14.3	15.4	14.7	15.7	16.0	15.5	16.6	15.9	16.9	17.2
4H 2H	12.9	14.1	13.2	14.3	14.6	13.8	15.0	14.1	15.2	15.5
3H	13.9	14.9	14.2	15.2	15.5	14.8	15.8	15.2	16.1	16.4
4H	14.4	15.3	14.8	15.7	16.0	15.3	16.3	15.7	16.6	16.9
6H	15.0	15.8	15.4	16.2	16.6	15.9	16.8	16.4	17.1	17.5
8H	15.3	16.1	15.7	16.4	16.8	16.3	17.0	16.7	17.4	17.8
12H	15.5	16.2	15.9	16.6	17.0	16.5	17.2	17.0	17.6	18.0
8H 4H	14.7	15.4	15.1	15.8	16.2	15.5	16.3	16.0	16.7	17.1
6H	15.5	16.1	15.9	16.5	17.0	16.4	17.1	16.9	17.5	17.9
8H	15.9	16.5	16.4	16.9	17.4	16.9	17.5	17.4	17.9	18.3
12H	16.2	16.7	16.7	17.1	17.6	17.3	17.8	17.8	18.2	18.7
12H 4H	14.7	15.4	15.2	15.8	16.2	15.6	16.3	16.0	16.7	17.1
6H	15.6	16.2	16.1	16.6	17.1	16.5	17.1	17.0	17.5	18.0
8H	16.1	16.6	16.6	17.1	17.5	17.0	17.5	17.5	18.0	18.5
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 0.6 / - 0.6					+ 0.5 / - 0.5				
1.5H	+ 0.3 / - 0.5					+ 0.3 / - 0.5				
2.0H	+ 1.0 / - 0.6					+ 1.1 / - 1.0				

CIE Pub.117, 3154 lm Total Lamp Luminous Flux Correct ($8\log(F/F_0) = 4.0$)
Area: 0.17 m²

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:Mr.Ma
Test Date:20 February 2024

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity:65.0%
Test Distance:6.200m [K=1.0000]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:229.68V I:0.1291A P:29.134W PF:0.9827 Freq:50.00Hz Lamp Flux:3154.17x1 lm		
NAME: Verso 1200 30W NW	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: PURATI PTY LTD	SUR.:	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	65	55	49	65	55	49	63	54	49	43
0.80	75	65	59	74	65	59	72	64	58	52
1.00	83	73	67	82	73	67	80	74	66	60
1.25	89	80	74	88	80	74	85	78	73	67
1.50	94	85	80	92	85	79	89	83	78	71
2.00	99	92	87	98	91	86	94	89	84	77
2.50	102	96	91	100	95	90	97	92	88	80
3.00	105	99	95	103	98	94	99	95	91	83
4.00	108	104	100	106	102	98	102	98	95	87
5.00	110	106	103	108	104	101	103	101	98	89
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Mr.Ma
Test Date:20 February 2024

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity:65.0%
Test Distance:6.200m [K=1.0000]
Remarks:

ISOCANDELA DIAGRAM

Test:U:229.68V I:0.1291A P:29.134W PF:0.9827 Freq:50.00Hz Lamp Flux:3154.17x1 lm		
NAME: Verso 1200 30W NW	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: PURATI PTY LTD	SUR.:	Shielding Angle:

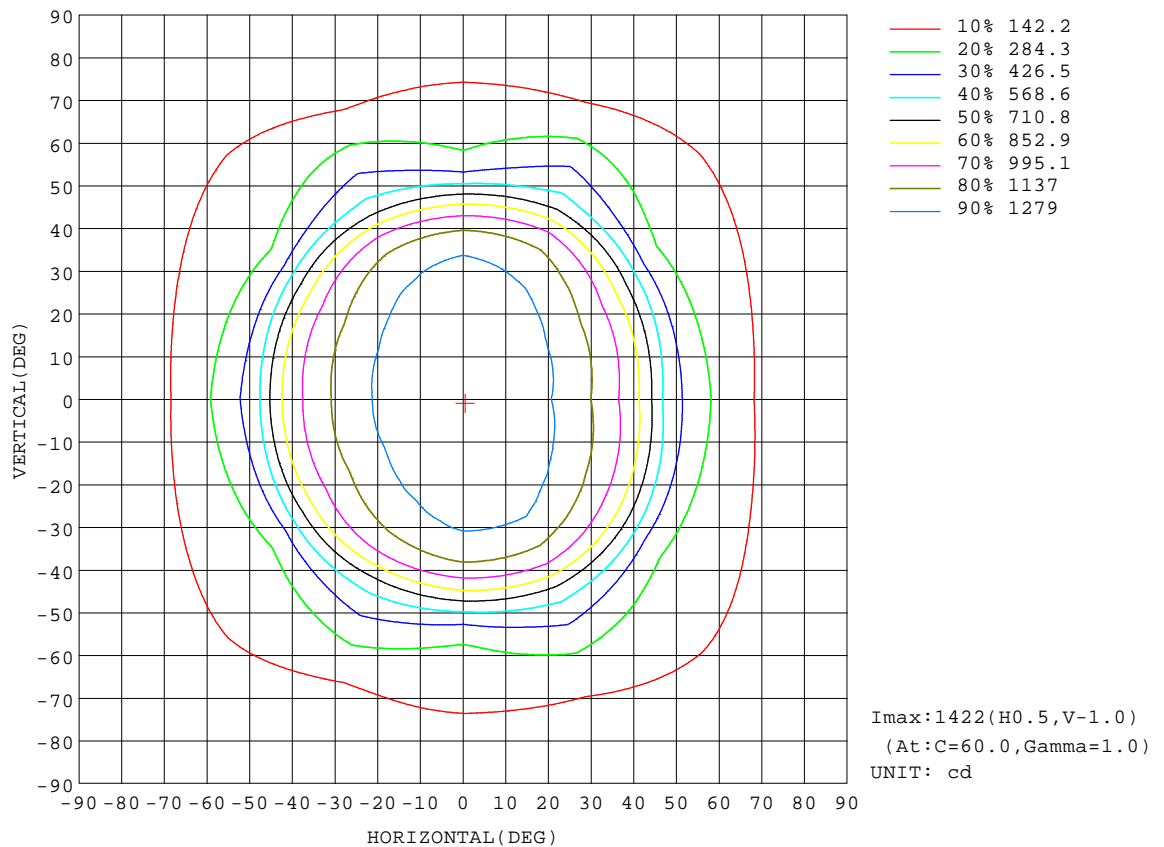


C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:Mr.Ma
Test Date:20 February 2024

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity:65.0%
Test Distance:6.200m [K=1.0000]
Remarks:

AAI Figure

Test:U:229.68V I:0.1291A P:29.134W PF:0.9827 Freq:50.00Hz Lamp Flux:3154.17x1 lm		
NAME: Verso 1200 30W NW	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: PURATI PTY LTD	SUR.:	Shielding Angle:

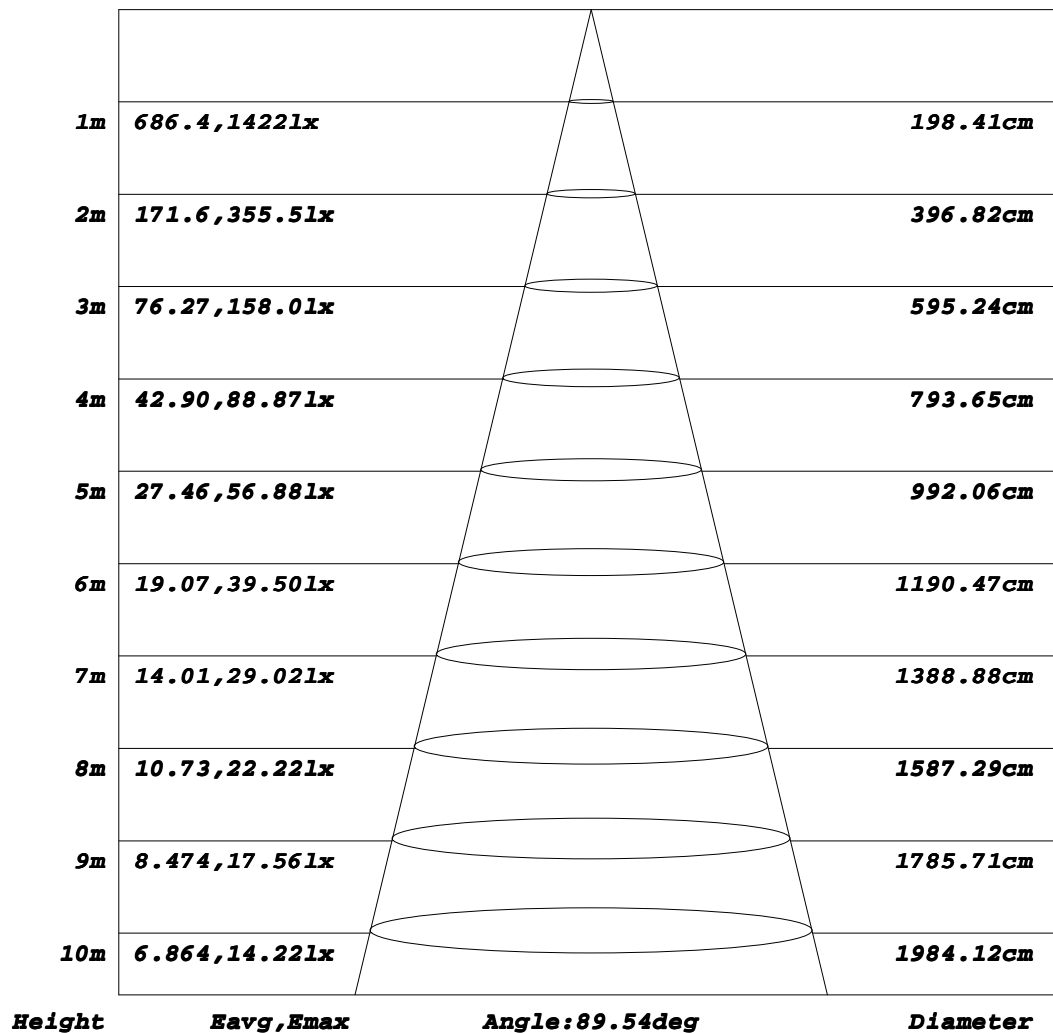
Flux out:2156 lm


Note: The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature: 25.3°C
Operators: Mr.Ma
Test Date: 20 February 2024
γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity: 65.0%
Test Distance: 6.200m [K=1.0000]
Remarks:

ISOLUX DIAGRAM

Test:U:229.68V I:0.1291A P:29.134W PF:0.9827 Freq:50.00Hz Lamp Flux:3154.17x1 lm		
NAME: Verso 1200 30W NW	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: PURATI PTY LTD	SUR.:	Shielding Angle:

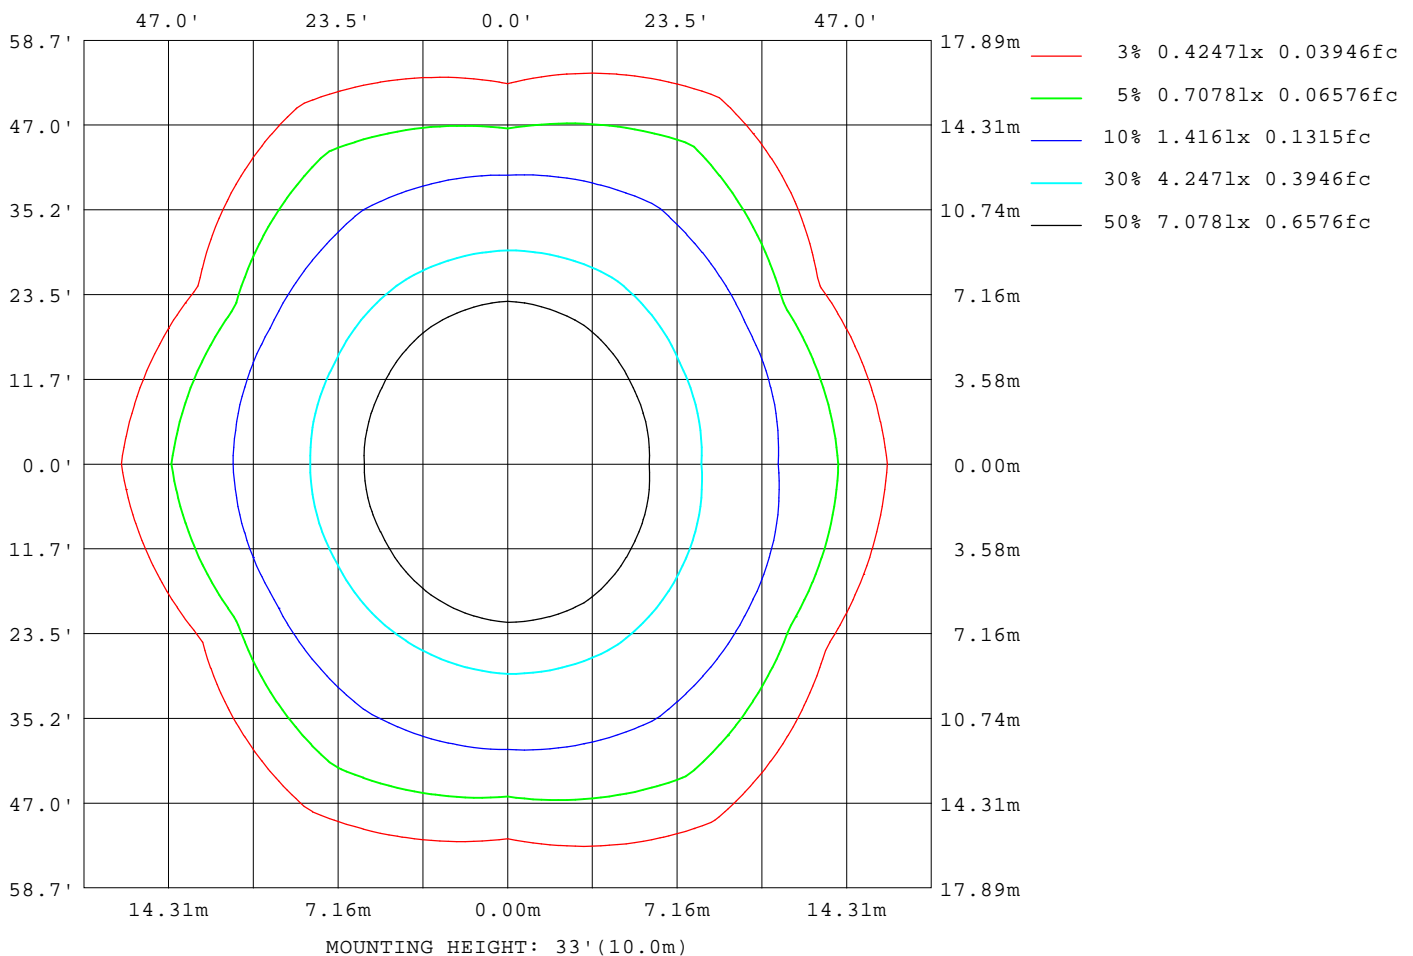

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature: 25.3°C
Operators: Mr. Ma
Test Date: 20 February 2024

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity: 65.0%
Test Distance: 6.200m [K=1.0000]
Remarks:

LED Avg.L Report

Test:U:229.68V I:0.1291A P:29.134W PF:0.9827 Freq:50.00Hz Lamp Flux:3154.17x1 lm		
NAME: Verso 1200 30W NW	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: PURATI PTY LTD	SUR.:	Shielding Angle:


AvgL	cd/m2
L_0~180(65)av	2587
L_0~180(75)av	2217
L_0~180(85)av	2396
L_90~270(65)av	2917
L_90~270(75)av	2878
L_90~270(85)av	3818
L_45(65)av	2981
L_45(75)av	2588
L_45(85)av	3126

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Mr.Ma
Test Date:20 February 2024

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity:65.0%
Test Distance:6.200m [K=1.0000]
Remarks:

Planar Illuminance Curve

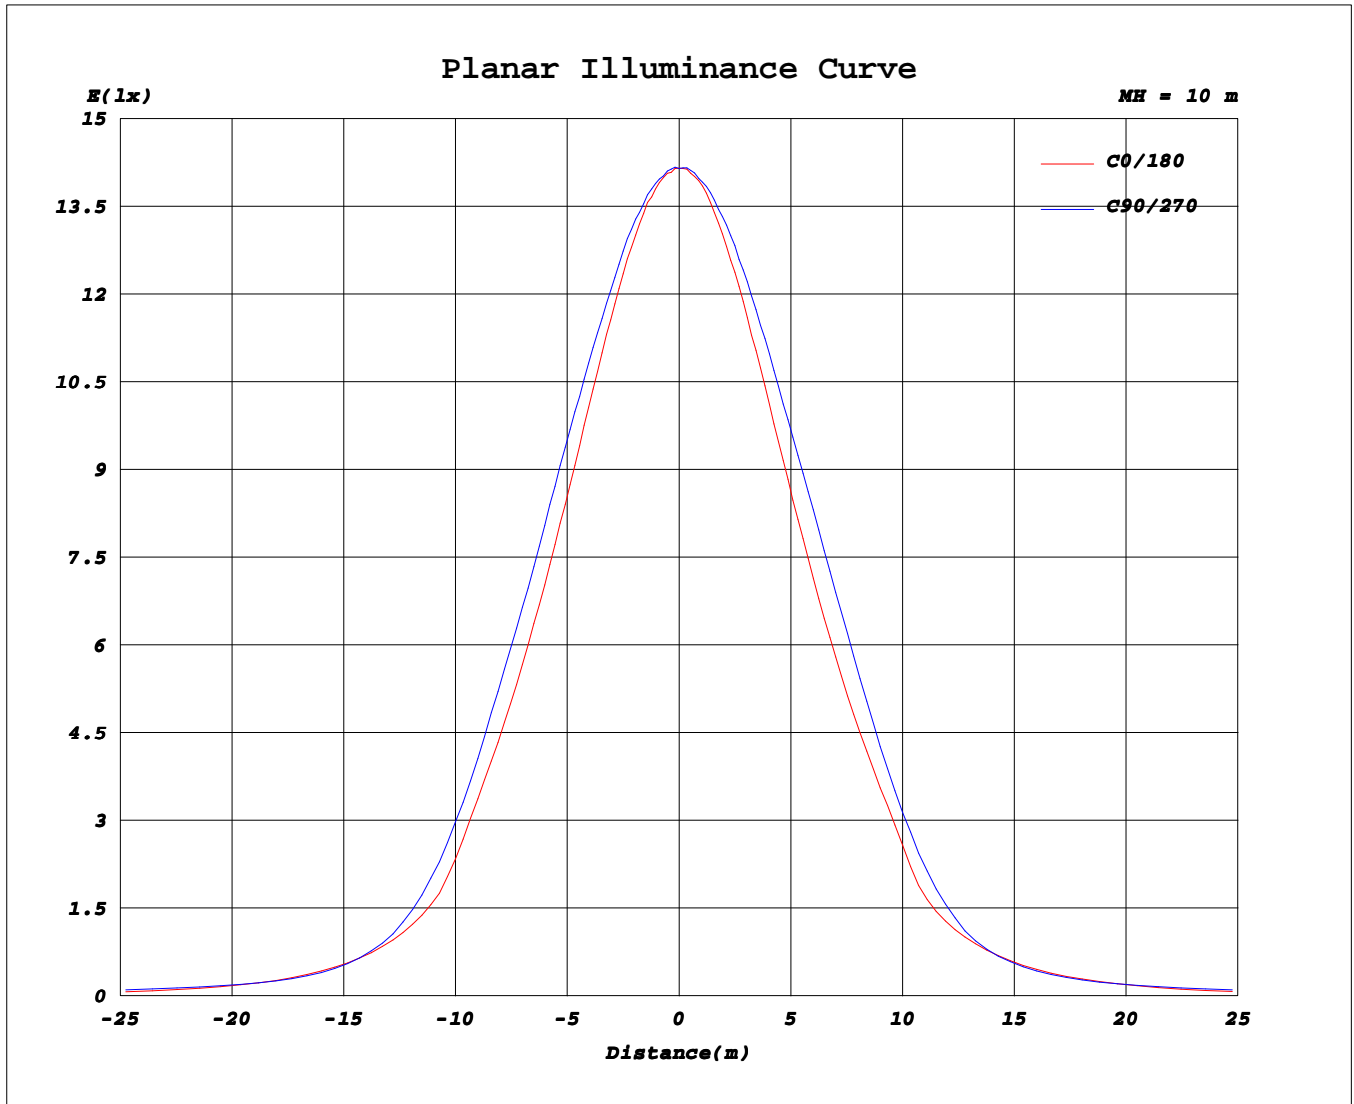

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature: 25.3°C
Operators: Mr.Ma
Test Date: 20 February 2024

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity: 65.0%
Test Distance: 6.200m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:229.68V I:0.1291A P:29.134W PF:0.9827 Freq:50.00Hz Lamp Flux:3154.17x1 lm																	
NAME: Verso 1200 30W NW									TYPE:						WEIGHT:		
SPEC.:									DIM.:						SERIAL No.:		
MFR.: PURATI PTY LTD									SUR.:						Shielding Angle:		

Table--1

UNIT: cd

C(DEG) γ (DEG)	0	30	60	90	120	150	180	210	240	270	300	330						
0	1416	1416	1416	1416	1416	1416	1416	1416	1416	1416	1416	1416						
5	1407	1411	1413	1414	1407	1409	1411	1408	1410	1415	1416	1413						
10	1383	1397	1406	1404	1393	1379	1384	1388	1399	1409	1409	1394						
15	1343	1362	1390	1390	1365	1344	1347	1355	1373	1398	1387	1362						
20	1288	1323	1367	1368	1330	1296	1295	1311	1346	1383	1359	1316						
25	1219	1269	1333	1343	1284	1234	1231	1255	1310	1361	1322	1259						
30	1137	1198	1287	1295	1225	1158	1152	1182	1263	1328	1273	1183						
35	1031	1106	1206	1210	1141	1061	1056	1089	1196	1256	1209	1087						
40	894	983	1087	1079	1004	932	932	960	1074	1123	1104	956						
45	664	783	872	844	753	701	730	730	838	888	903	737						
50	462	518	624	558	546	428	484	455	595	593	641	478						
55	346	316	468	346	417	267	367	276	465	361	498	291						
60	251	223	347	241	306	192	271	203	354	258	383	206						
65	180	187	244	207	214	177	192	185	239	212	271	182						
70	123	175	166	187	132	156	121	165	149	193	173	164						
75	103	120	126	123	115	93.8	92.6	103	121	131	121	110						
80	85.1	83.4	112	92.0	86.0	74.2	85.2	74.3	108	89.4	121	79.8						
85	33.8	50.8	56.9	51.6	32.4	35.5	37.3	33.6	48.8	61.5	66.4	45.8						
90	0.38	0.43	0.58	0.53	0.51	0.40	0.53	0.57	0.63	2.47	7.33	0.58						
95	0.48	0.50	0.64	0.68	0.65	0.51	0.60	0.65	0.76	0.74	0.67	0.60						
100	0.61	0.62	0.81	0.88	0.84	0.64	0.69	0.75	0.92	0.90	0.80	0.69						
105	0.77	0.79	1.05	1.17	1.11	0.80	0.82	0.91	1.16	1.14	0.99	0.82						
110	1.00	1.03	1.37	1.52	1.46	1.05	1.01	1.16	1.46	1.45	1.25	1.02						
115	1.35	1.40	1.73	1.85	1.85	1.42	1.29	1.54	1.81	1.79	1.60	1.33						
120	1.83	1.89	2.12	2.30	2.25	1.91	1.72	1.99	2.20	2.18	1.98	1.78						
125	2.40	2.44	2.55	2.75	2.69	2.44	2.21	2.49	2.60	2.62	2.36	2.30						
130	2.97	2.96	3.01	3.23	3.15	2.96	2.74	2.96	3.05	3.07	2.77	2.84						
135	3.46	3.44	3.50	3.71	3.61	3.42	3.21	3.40	3.47	3.52	3.21	3.29						
140	3.89	3.91	4.00	4.14	4.03	3.86	3.58	3.81	3.90	3.96	3.68	3.74						
145	4.32	4.40	4.47	4.58	4.44	4.25	3.98	4.19	4.29	4.39	4.18	4.19						
150	4.78	4.92	4.90	4.98	4.81	4.62	4.40	4.56	4.67	4.79	4.65	4.68						
155	5.32	5.47	5.29	5.34	5.18	5.04	4.88	4.96	5.05	5.17	5.07	5.23						
160	5.85	5.94	5.65	5.68	5.56	5.48	5.42	5.37	5.45	5.53	5.46	5.76						
165	6.36	6.26	5.94	5.95	5.88	5.89	5.93	5.77	5.82	5.83	5.79	6.19						
170	6.77	6.49	6.20	6.20	6.15	6.23	6.40	6.12	6.09	6.12	6.09	6.50						
175	7.12	6.68	6.42	6.39	6.35	6.51	6.73	6.39	6.29	6.29	6.31	6.63						
180	7.21	6.74	6.51	6.48	6.50	6.76	7.21	6.74	6.52	6.47	6.49	6.75						

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Mr.Ma
Test Date:20 February 2024
γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity:65.0%
Test Distance:6.200m [K=1.0000]
Remarks: