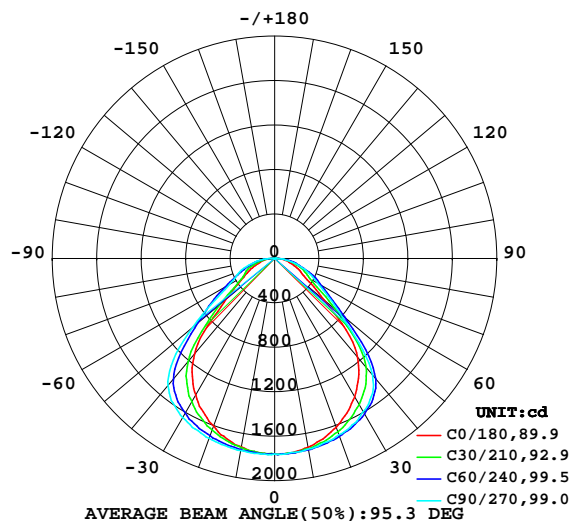
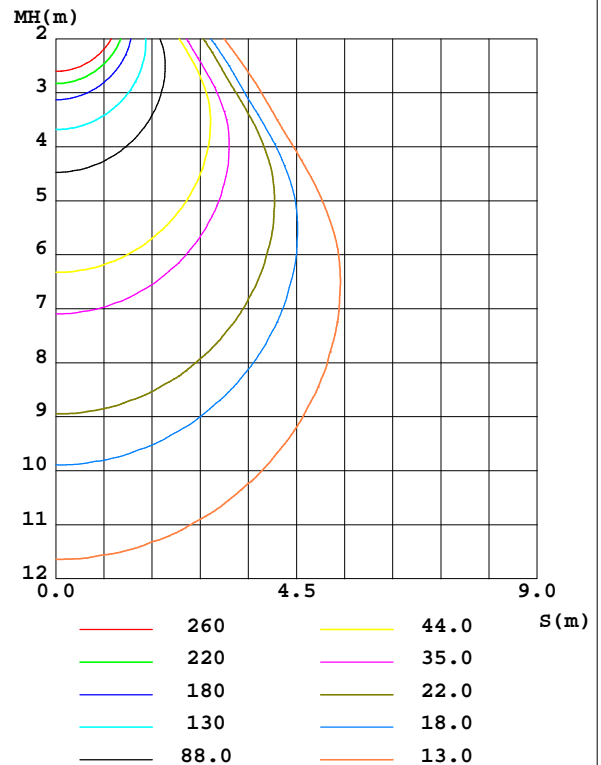


LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:229.49V I:0.1703A P:38.354W PF:0.9811 Freq:50.00Hz Lamp Flux:4107.92x1 lm		
NAME: Verso 1500 40W NW	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: PURATI PTY LTD	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 107.10 lm/W
MODEL		Imax(cd)	1766	S/MH(C0/180)		1.21
NOMINAL POWER(W)	40	LOR(%)	100.0	S/MH(C90/270)		1.40
RATED VOLTAGE(V)	230	TOTAL FLUX(lm)	4107.9	η UP,DN(C0-180)		0.3,48.3
NOMINAL FLUX(lm)	4107.92	CIE CLASS	DIRECT	η UP,DN(C180-360)		0.3,51.1
LAMPS INSIDE	1	η up(%)	0.6	CIBSE SHR NOM		1.25
TEST VOLTAGE(V)	229.3	η down(%)	99.4	CIBSE SHR MAX		1.35

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)


C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:Mr.Ma
Test Date:20 February 2024

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity:65.0%
Test Distance:6.700m [K=1.0000]
Remarks:

ZONAL FLUX DIAGRAM
ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum,lamp
10	1727	1745	1741	1718	1723	1737	1754	1744	0- 10	166.9	166.9	4.06,4.06
20	1617	1682	1689	1609	1605	1671	1722	1664	10- 20	481.1	648.0	15.8,15.8
30	1439	1569	1593	1435	1422	1549	1653	1520	20- 30	736.5	1384	33.7,33.7
40	1161	1348	1371	1107	1122	1316	1492	1292	30- 40	884.6	2269	55.2,55.2
50	581.9	772.3	768.0	547.8	567.6	769.8	961.2	749.2	40- 50	772.7	3042	74,74
60	294.5	426.6	451.3	321.0	310.6	422.2	469.1	381.1	50- 60	467.0	3509	85.4,85.4
70	185.5	275.9	285.4	202.2	186.0	268.3	326.7	247.5	60- 70	311.3	3820	93,93
80	101.9	144.7	135.1	94.39	102.0	145.6	174.4	139.2	70- 80	195.4	4015	97.7,97.7
90	0.6278	0.8564	0.9280	0.6893	0.7818	0.9852	14.81	13.84	80- 90	69.09	4085	99.4,99.4
100	0.9026	1.242	1.537	1.110	1.044	1.379	1.452	1.092	90-100	1.315	4086	99.5,99.5
110	1.451	2.022	2.444	1.930	1.556	2.179	2.159	1.620	100-110	1.627	4087	99.5,99.5
120	2.574	3.151	3.511	3.244	2.665	3.307	3.095	2.629	110-120	2.426	4090	99.6,99.6
130	4.211	4.469	4.804	4.721	4.225	4.568	4.289	3.969	120-130	3.326	4093	99.6,99.6
140	5.651	5.801	6.156	5.976	5.485	5.818	5.652	5.274	130-140	3.923	4097	99.7,99.7
150	7.018	7.131	7.325	7.005	6.540	6.920	6.899	6.638	140-150	3.960	4101	99.8,99.8
160	8.622	8.299	8.295	8.091	7.813	7.976	7.998	8.059	150-160	3.471	4105	99.9,99.9
170	9.918	9.077	9.027	9.014	9.066	8.875	8.856	9.190	160-170	2.434	4107	100,100
180	10.18	9.539	9.422	9.734	10.17	9.541	9.418	9.706	170-180	0.8897	4108	100,100
DEG	LUMINOUS INTENSITY:cd									UNIT: lm		


Conical surface Flux(90deg): 2695.9 lm
%lum = 65.6%
%lamp = 65.6%
Conical surface Flux(130deg): 3677.6 lm
%lum = 89.5%
%lamp = 89.5%

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:Mr.Ma
Test Date:20 February 2024

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity:65.0%
Test Distance:6.700m [K=1.0000]
Remarks:

LUMINANCE LIMITATION CURVES

Test:U:229.49V I:0.1703A P:38.354W PF:0.9811 Freq:50.00Hz Lamp Flux:4107.92x1 lm		
NAME: Verso 1500 40W NW	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: PURATI PTY LTD	SUR.:	Shielding Angle:

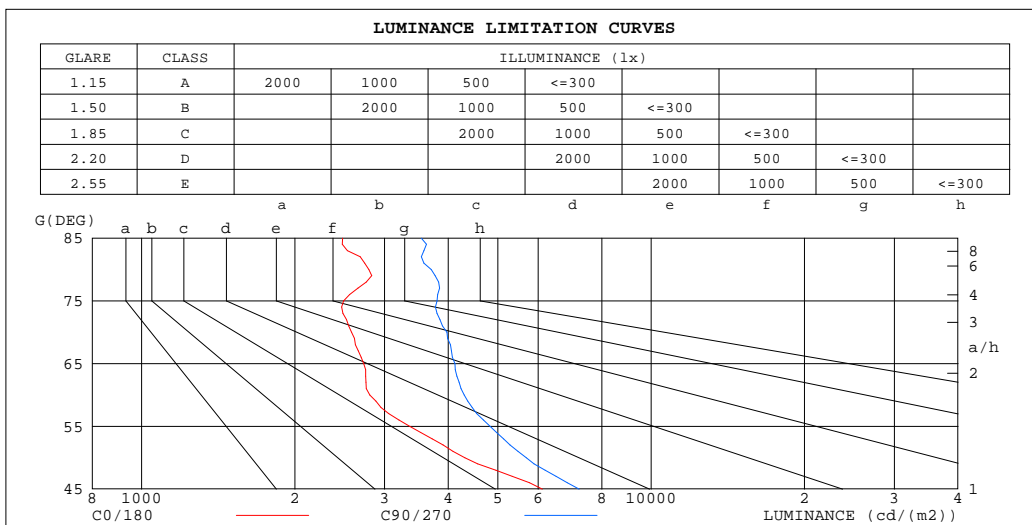

LUMINANCE cd/(m2)		
G(DEG)	C0/180	C90/270
85	2480	3541
80	2795	3703
75	2492	3801
70	2583	3972
65	2729	4121
60	2804	4297
55	3361	4834
50	4310	5688
45	6114	7226


C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature: 25.3°C
Operators: Mr.Ma
Test Date: 20 February 2024

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity: 65.0%
Test Distance: 6.700m [K=1.0000]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:229.49V I:0.1703A P:38.354W PF:0.9811 Freq:50.00Hz Lamp Flux:4107.92x1 lm		
NAME: Verso 1500 40W NW	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: PURATI PTY LTD	SUR.:	Shielding Angle:

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio Coefficients of Utilization(CU)															
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	.99
1.0	1.05	1.02	.98	1.03	.90	.96	.99	.96	.93	.95	.93	.90	.91	.89	.88	.86
2.0	.93	.87	.82	.92	.86	.81	.88	.83	.79	.85	.81	.77	.82	.78	.76	.73
3.0	.83	.76	.70	.82	.75	.69	.79	.73	.68	.76	.71	.67	.73	.69	.66	.64
4.0	.75	.67	.61	.73	.66	.60	.71	.64	.59	.69	.63	.58	.66	.62	.58	.56
5.0	.68	.59	.53	.66	.59	.53	.64	.57	.52	.62	.56	.52	.60	.55	.51	.49
6.0	.61	.53	.47	.60	.52	.47	.59	.52	.46	.57	.51	.46	.55	.50	.45	.44
7.0	.56	.48	.42	.55	.47	.42	.54	.47	.41	.52	.46	.41	.51	.45	.41	.39
8.0	.51	.43	.38	.51	.43	.38	.49	.42	.37	.48	.42	.37	.47	.41	.37	.35
9.0	.47	.39	.34	.47	.39	.34	.45	.39	.34	.44	.38	.34	.43	.38	.34	.32
10.0	.44	.36	.31	.43	.36	.31	.42	.36	.31	.41	.35	.31	.40	.35	.31	.29

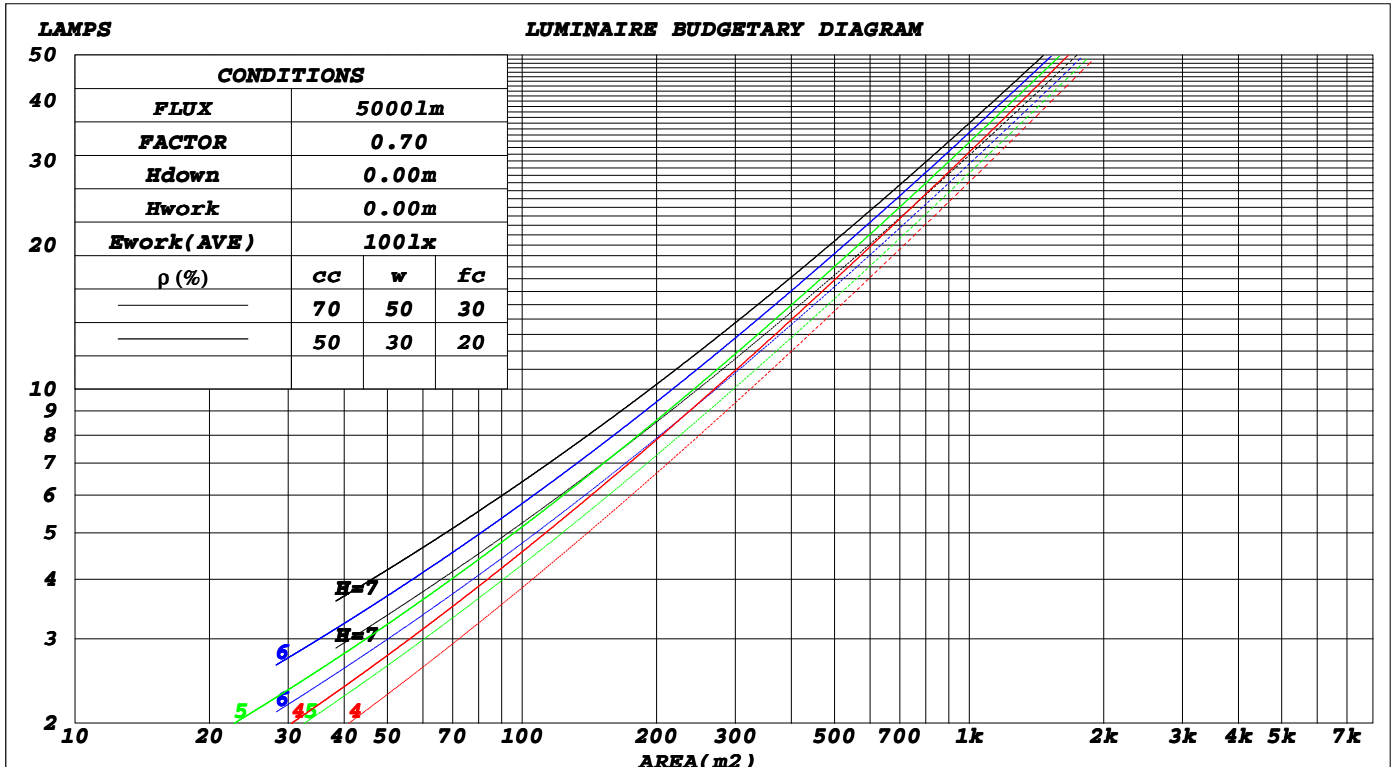

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature: 25.3°C
Operators: Mr.Ma
Test Date: 20 February 2024

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 γ Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity: 65.0%
Test Distance: 6.700m [K=1.0000]
Remarks:

WEC AND CCEC

Test:U:229.49V I:0.1703A P:38.354W PF:0.9811 Freq:50.00Hz Lamp Flux:4107.92x1 lm		
NAME: Verso 1500 40W NW	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: PURATI PTY LTD	SUR.:	Shielding Angle:

ρ_{cc}	80%			70%			50%			30%			10%			0														
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0														
ρ_{fc}	20%			20%			20%			20%			20%			0														
RCR	RCR:Room Cavity Ratio															Wall Exitance Coefficients(WEC)														
0.0																														
1.0	.277	.158	.050	.270	.154	.049	.256	.147	.047	.244	.141	.045	.233	.135	.044															
2.0	.261	.143	.044	.255	.140	.043	.243	.135	.042	.232	.130	.041	.222	.126	.040															
3.0	.244	.130	.039	.238	.127	.038	.228	.123	.038	.218	.120	.037	.209	.116	.036															
4.0	.227	.118	.035	.222	.116	.034	.213	.113	.034	.204	.110	.033	.196	.107	.033															
5.0	.211	.108	.031	.207	.106	.031	.199	.104	.031	.192	.101	.030	.185	.099	.030															
6.0	.198	.099	.028	.194	.098	.028	.187	.096	.028	.180	.094	.027	.174	.091	.027															
7.0	.185	.092	.026	.182	.091	.026	.175	.089	.026	.169	.087	.025	.164	.085	.025															
8.0	.174	.085	.024	.171	.084	.024	.165	.083	.024	.160	.081	.023	.155	.079	.023															
9.0	.164	.079	.022	.161	.079	.022	.156	.077	.022	.151	.076	.022	.147	.075	.022															
10.0	.155	.074	.021	.153	.074	.021	.148	.073	.020	.144	.071	.020	.139	.070	.020															

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio Ceiling Cavity Exitance Coefficients(CCEC)															
0.0	.195	.195	.195	.166	.166	.166	.114	.114	.114	.065	.065	.065	.021	.021	.021	
1.0	.182	.161	.141	.156	.138	.122	.107	.095	.084	.061	.055	.049	.020	.018	.016	
2.0	.173	.136	.106	.148	.117	.092	.101	.081	.064	.058	.047	.038	.019	.015	.012	
3.0	.164	.119	.082	.140	.102	.071	.096	.071	.050	.056	.041	.030	.018	.013	.010	
4.0	.156	.105	.066	.134	.091	.057	.092	.063	.040	.053	.037	.024	.017	.012	.008	
5.0	.148	.094	.054	.127	.082	.047	.088	.057	.033	.051	.033	.020	.016	.011	.007	
6.0	.141	.086	.046	.121	.074	.040	.084	.052	.028	.049	.031	.017	.016	.010	.006	
7.0	.135	.079	.040	.116	.068	.034	.080	.048	.024	.047	.028	.015	.015	.009	.005	
8.0	.129	.073	.035	.111	.063	.030	.077	.044	.021	.045	.026	.013	.014	.009	.004	
9.0	.123	.068	.031	.106	.059	.027	.073	.041	.019	.043	.025	.011	.014	.008	.004	
10.0	.118	.064	.028	.101	.055	.024	.070	.039	.017	.041	.023	.010	.013	.008	.003	

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:Mr.Ma
Test Date:20 February 2024
 γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity:65.0%
Test Distance:6.700m [K=1.0000]
Remarks:

UGR(Unified Glare Rating) Table

Test:U:229.49V I:0.1703A P:38.354W PF:0.9811 Freq:50.00Hz Lamp Flux:4107.92x1 lm										
NAME: Verso 1500 40W NW					TYPE:			WEIGHT:		
SPEC.:					DIM.:			SERIAL No.:		
MFR.: PURATI PTY LTD					SUR.:			Shielding Angle:		
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	12.1	13.5	12.3	13.7	13.9	13.5	14.9	13.7	15.1	15.3
3H	12.9	14.2	13.2	14.4	14.7	14.5	15.8	14.8	16.1	16.3
4H	13.3	14.5	13.6	14.7	15.0	15.0	16.2	15.3	16.5	16.7
6H	13.7	14.8	14.0	15.1	15.4	15.5	16.6	15.8	16.9	17.2
8H	13.8	14.9	14.2	15.2	15.5	15.6	16.7	16.0	17.0	17.3
12H	13.9	15.0	14.3	15.3	15.6	15.7	16.8	16.1	17.1	17.4
4H 2H	12.6	13.8	12.9	14.1	14.3	13.8	15.0	14.1	15.2	15.5
3H	13.7	14.8	14.1	15.1	15.4	15.1	16.2	15.5	16.5	16.8
4H	14.3	15.3	14.7	15.6	15.9	15.8	16.7	16.1	17.1	17.4
6H	14.9	15.7	15.3	16.1	16.4	16.4	17.3	16.8	17.6	18.0
8H	15.1	15.9	15.5	16.2	16.6	16.6	17.4	17.0	17.8	18.2
12H	15.2	15.9	15.6	16.3	16.7	16.8	17.5	17.2	17.9	18.3
8H 4H	14.7	15.5	15.1	15.9	16.3	16.0	16.8	16.4	17.2	17.6
6H	15.5	16.1	15.9	16.5	17.0	16.8	17.5	17.3	17.9	18.3
8H	15.8	16.4	16.3	16.8	17.3	17.2	17.8	17.6	18.2	18.6
12H	16.0	16.5	16.5	17.0	17.5	17.5	18.0	18.0	18.4	18.9
12H 4H	14.8	15.5	15.2	15.9	16.3	16.0	16.7	16.4	17.1	17.5
6H	15.6	16.2	16.1	16.6	17.1	16.9	17.5	17.4	17.9	18.4
8H	16.0	16.5	16.5	17.0	17.4	17.3	17.8	17.8	18.3	18.7
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 0.5 / - 0.5					+ 0.4 / - 0.4				
1.5H	+ 0.2 / - 0.5					+ 0.2 / - 0.4				
2.0H	+ 0.9 / - 0.8					+ 0.7 / - 0.5				

CIE Pub.117, 4108 lm Total Lamp Luminous Flux Correct ($8\log(F/F_0) = 4.9$)
Area: 0.21 m²

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:Mr.Ma
Test Date:20 February 2024

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity:65.0%
Test Distance:6.700m [K=1.0000]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:229.49V I:0.1703A P:38.354W PF:0.9811 Freq:50.00Hz Lamp Flux:4107.92x1 lm		
NAME: Verso 1500 40W NW	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: PURATI PTY LTD	SUR.:	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	64	53	47	63	53	47	62	53	47	41
0.80	74	63	57	73	63	57	71	62	56	50
1.00	82	72	65	80	71	65	78	72	64	58
1.25	88	79	73	87	78	72	84	77	71	65
1.50	92	84	78	91	83	77	88	81	76	69
2.00	98	91	85	97	90	85	93	88	83	76
2.50	102	95	90	100	93	89	96	91	87	79
3.00	104	98	94	102	97	93	98	94	90	82
4.00	108	103	99	106	101	97	101	98	95	86
5.00	110	106	102	108	104	100	103	100	97	88
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Mr.Ma
Test Date:20 February 2024

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity:65.0%
Test Distance:6.700m [K=1.0000]
Remarks:

ISOCANDELA DIAGRAM

Test:U:229.49V I:0.1703A P:38.354W PF:0.9811 Freq:50.00Hz Lamp Flux:4107.92x1 lm		
NAME: Verso 1500 40W NW	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: PURATI PTY LTD	SUR.:	Shielding Angle:

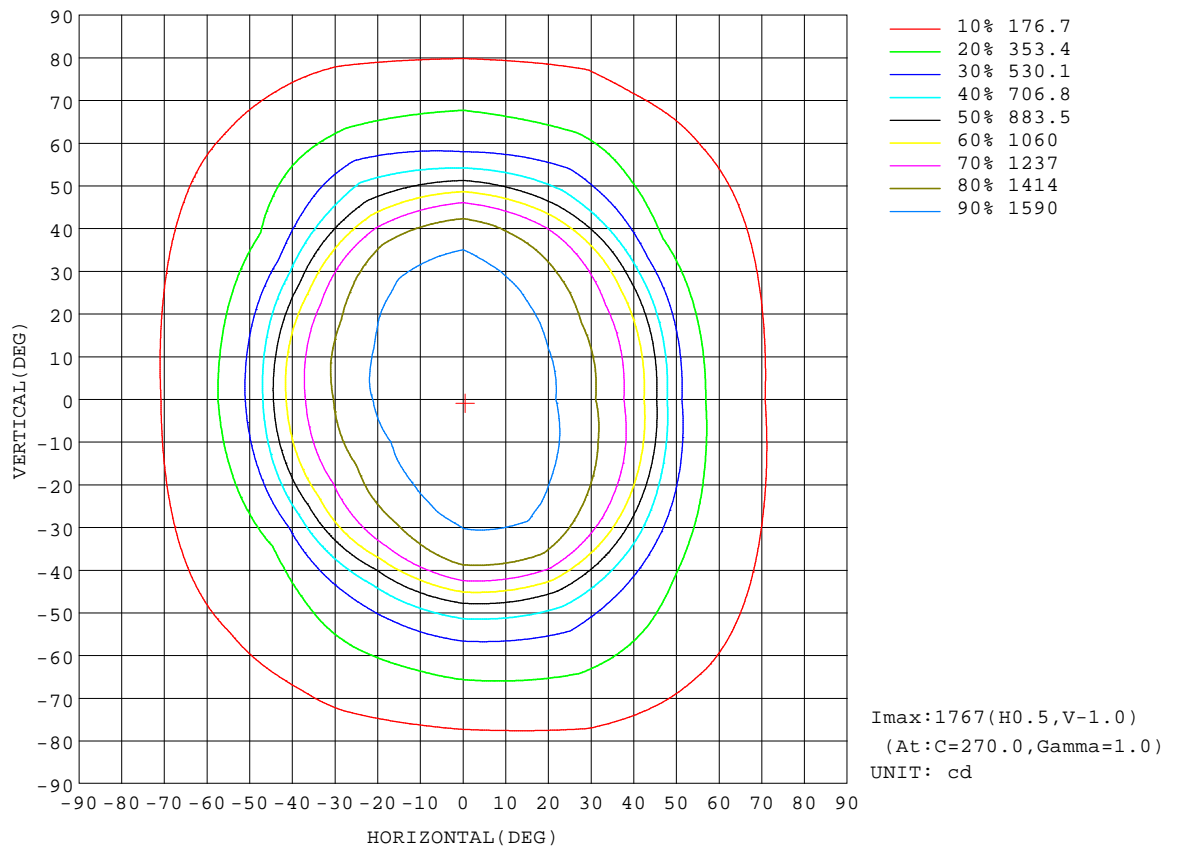


C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3°C
Operators:Mr.Ma
Test Date:20 February 2024

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity:65.0%
Test Distance:6.700m [K=1.0000]
Remarks:

AAI Figure

Test:U:229.49V I:0.1703A P:38.354W PF:0.9811 Freq:50.00Hz Lamp Flux:4107.92x1 lm		
NAME: Verso 1500 40W NW	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: PURATI PTY LTD	SUR.:	Shielding Angle:

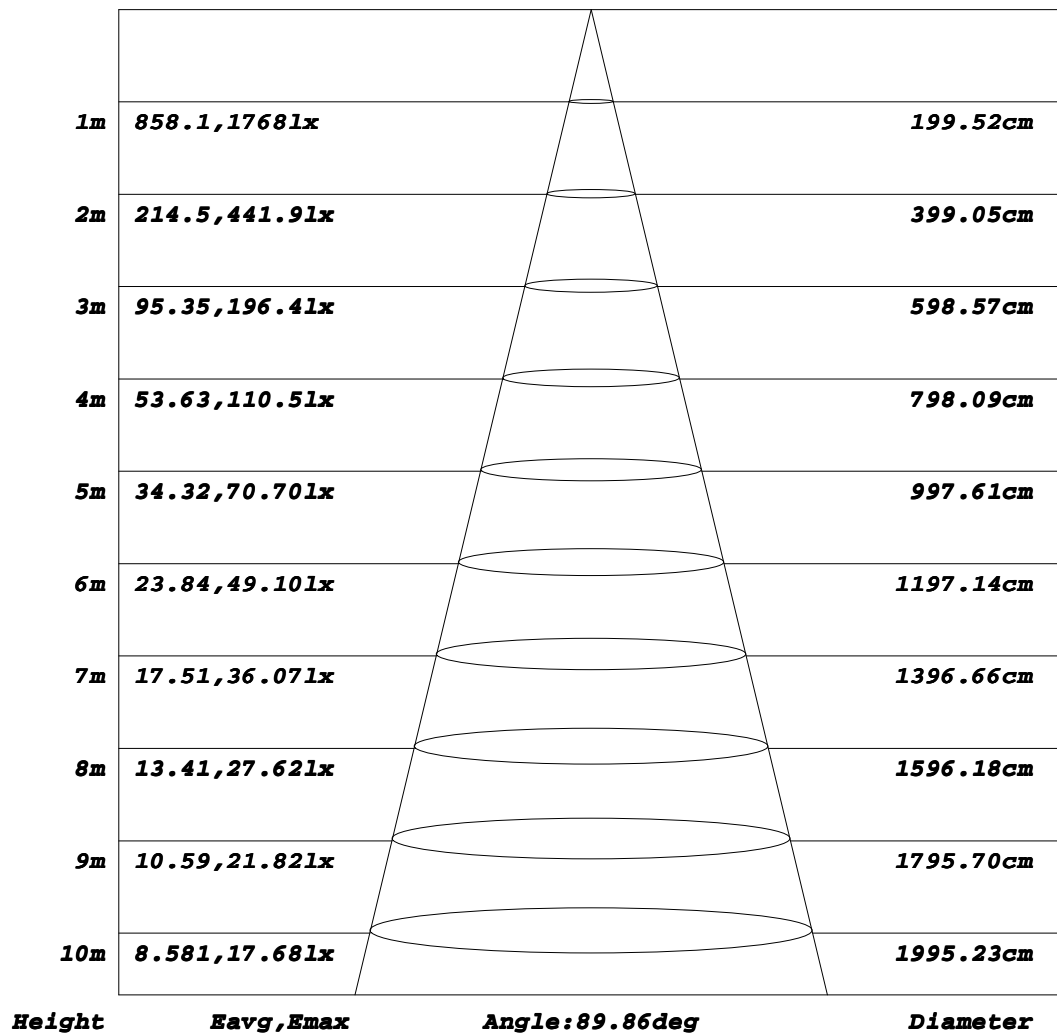Flux out:2696 lm


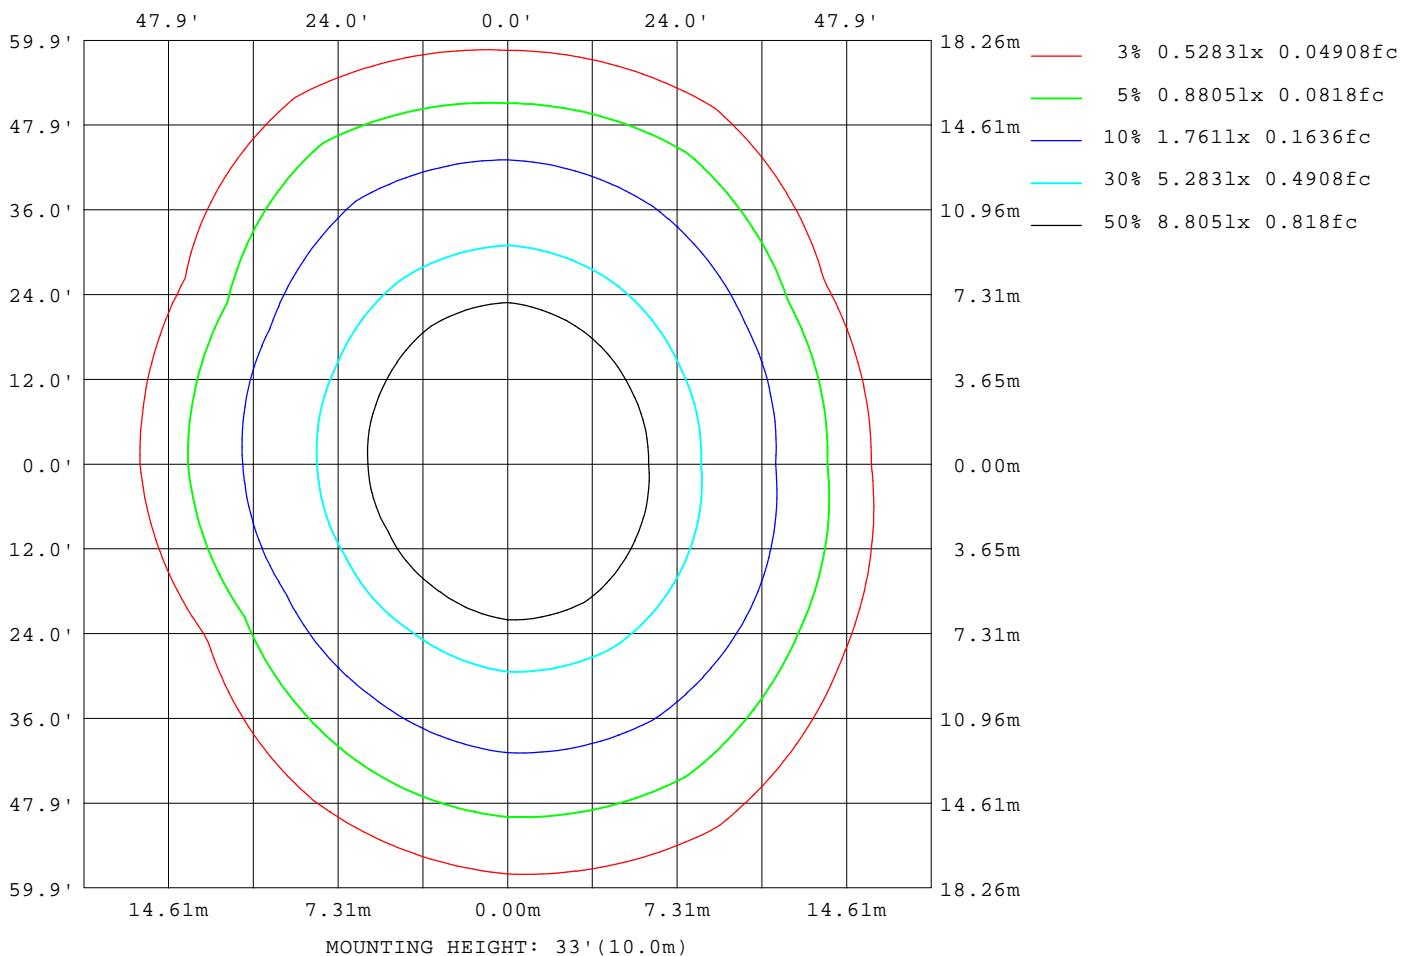
Note: The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature: 25.3°C
Operators: Mr.Ma
Test Date: 20 February 2024

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity: 65.0%
Test Distance: 6.700m [K=1.0000]
Remarks:

ISOLUX DIAGRAM

Test:U:229.49V I:0.1703A P:38.354W PF:0.9811 Freq:50.00Hz Lamp Flux:4107.92x1 lm		
NAME: Verso 1500 40W NW	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: PURATI PTY LTD	SUR.:	Shielding Angle:



C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature: 25.3°C
Operators: Mr. Ma
Test Date: 20 February 2024

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity: 65.0%
Test Distance: 6.700m [K=1.0000]
Remarks:

LED Avg.L Report

Test:U:229.49V I:0.1703A P:38.354W PF:0.9811 Freq:50.00Hz Lamp Flux:4107.92x1 lm		
NAME: Verso 1500 40W NW	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: PURATI PTY LTD	SUR.:	Shielding Angle:


AvgL	cd/m2
L_0~180(65)av	2747
L_0~180(75)av	2501
L_0~180(85)av	2496
L_90~270(65)av	4214
L_90~270(75)av	4133
L_90~270(85)av	4459
L_45(65)av	3579
L_45(75)av	3373
L_45(85)av	3505

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Mr.Ma
Test Date:20 February 2024

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity:65.0%
Test Distance:6.700m [K=1.0000]
Remarks:

Planar Illuminance Curve

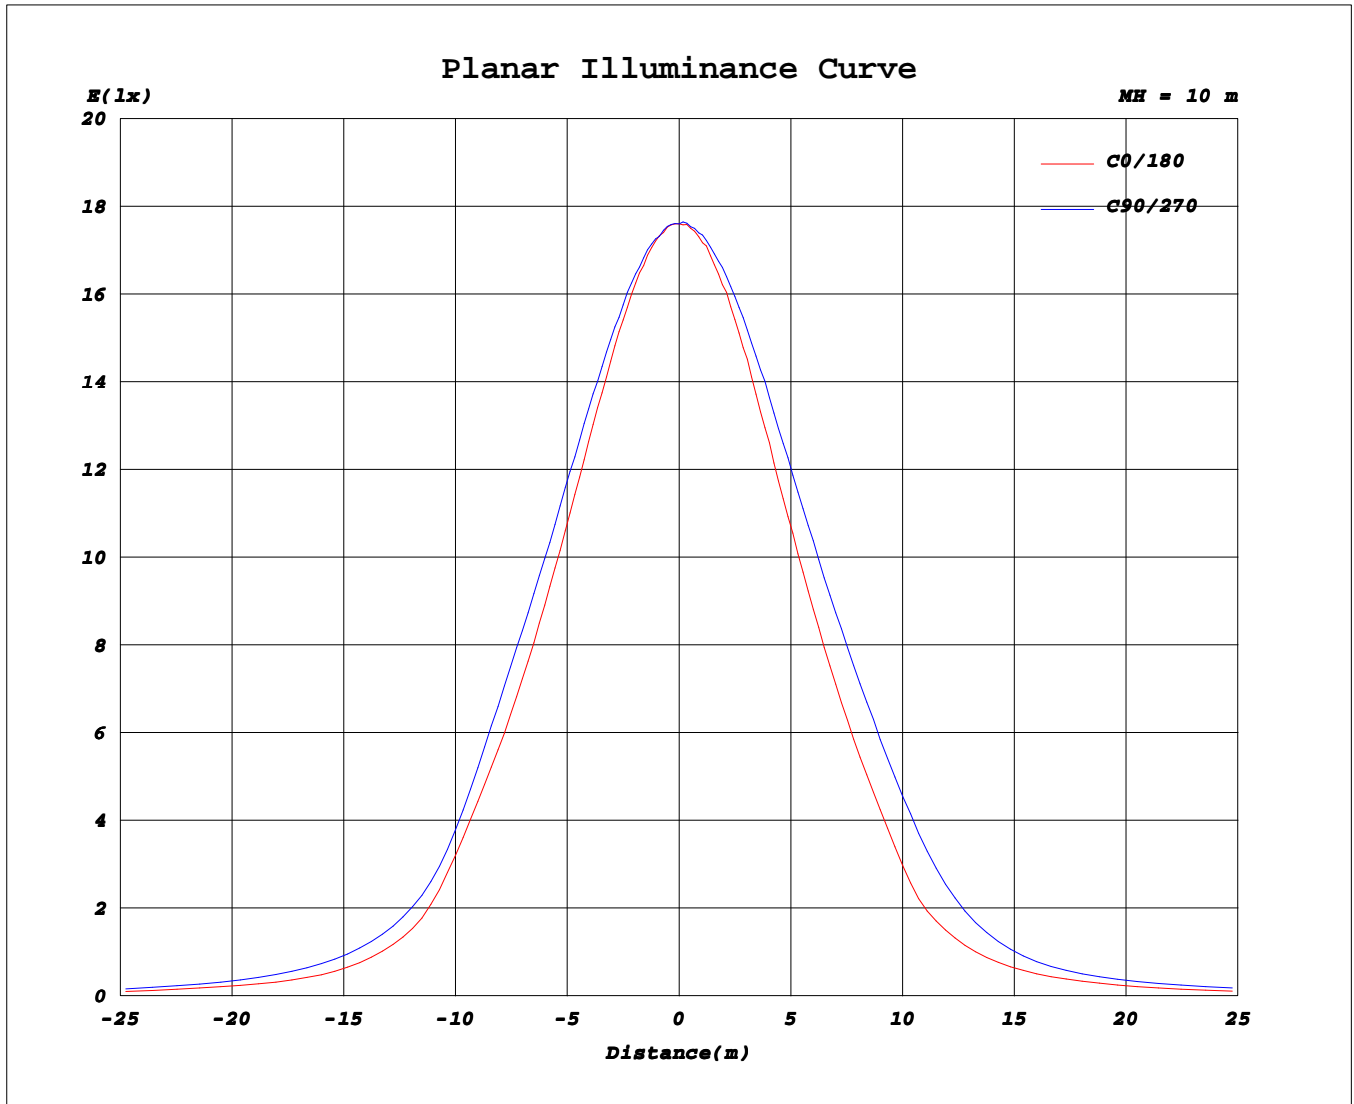

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature: 25.3°C
Operators: Mr.Ma
Test Date: 20 February 2024

γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity: 65.0%
Test Distance: 6.700m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:229.49V I:0.1703A P:38.354W PF:0.9811 Freq:50.00Hz Lamp Flux:4107.92x1 lm																	
NAME: Verso 1500 40W NW									TYPE:			WEIGHT:					
SPEC.:									DIM.:			SERIAL No.:					
MFR.: PURATI PTY LTD									SUR.:			Shielding Angle:					

Table--1

UNIT: cd

C(DEG) γ (DEG)	0	30	60	90	120	150	180	210	240	270	300	330						
0	1761	1761	1761	1761	1761	1761	1761	1761	1761	1761	1761	1761						
5	1754	1758	1758	1753	1748	1746	1751	1751	1757	1760	1762	1758						
10	1727	1741	1749	1741	1722	1715	1723	1730	1745	1754	1752	1736						
15	1680	1708	1730	1717	1682	1665	1678	1693	1726	1743	1727	1696						
20	1617	1660	1704	1689	1629	1589	1605	1643	1699	1722	1688	1640						
25	1537	1598	1668	1651	1561	1505	1523	1578	1661	1693	1630	1566						
30	1439	1521	1617	1593	1471	1399	1422	1491	1607	1653	1564	1475						
35	1317	1420	1543	1516	1350	1262	1294	1376	1536	1591	1479	1364						
40	1161	1281	1416	1371	1148	1066	1122	1213	1419	1492	1361	1222						
45	908	1033	1157	1073	825	760	843	930	1189	1289	1170	1007						
50	582	718	827	768	604	491	568	636	904	961	842	656						
55	405	494	618	583	460	332	407	423	694	660	627	427						
60	295	369	484	451	376	265	311	330	515	469	461	301						
65	242	309	400	366	298	234	245	287	386	382	362	257						
70	186	256	295	285	221	183	186	241	296	327	275	220						
75	135	186	216	207	175	126	136	172	225	243	206	157						
80	102	132	158	135	107	82.0	102	122	169	174	165	113						
85	45.4	63.7	78.6	64.8	31.9	27.3	46.0	59.1	94.7	98.4	93.0	64.3						
90	0.63	0.79	0.92	0.93	0.76	0.62	0.78	0.87	1.10	14.8	21.4	6.24						
95	0.73	0.84	1.12	1.18	0.94	0.78	0.89	1.01	1.25	1.20	0.99	0.91						
100	0.90	1.05	1.44	1.54	1.24	0.98	1.04	1.22	1.54	1.45	1.15	1.03						
105	1.13	1.35	1.83	1.96	1.67	1.25	1.26	1.53	1.92	1.78	1.40	1.21						
110	1.45	1.77	2.27	2.44	2.23	1.63	1.56	2.00	2.36	2.16	1.77	1.46						
115	1.92	2.33	2.76	2.96	2.88	2.19	2.00	2.63	2.82	2.61	2.26	1.84						
120	2.57	3.01	3.29	3.51	3.54	2.95	2.67	3.29	3.33	3.09	2.85	2.41						
125	3.36	3.71	3.90	4.13	4.20	3.77	3.44	3.93	3.91	3.64	3.45	3.13						
130	4.21	4.38	4.55	4.80	4.87	4.57	4.23	4.58	4.55	4.29	4.05	3.89						
135	4.97	5.02	5.25	5.50	5.52	5.24	4.89	5.24	5.19	4.98	4.64	4.64						
140	5.65	5.67	5.93	6.16	6.10	5.85	5.48	5.83	5.81	5.65	5.25	5.30						
145	6.31	6.36	6.57	6.76	6.62	6.38	6.01	6.34	6.42	6.30	5.90	5.96						
150	7.02	7.11	7.15	7.32	7.12	6.89	6.54	6.86	6.98	6.90	6.62	6.66						
155	7.83	7.81	7.71	7.83	7.61	7.48	7.15	7.37	7.53	7.47	7.29	7.43						
160	8.62	8.39	8.21	8.30	8.12	8.06	7.81	7.90	8.05	8.00	7.89	8.23						
165	9.34	8.79	8.60	8.68	8.55	8.64	8.45	8.44	8.50	8.44	8.37	8.97						
170	9.92	9.20	8.96	9.03	8.92	9.11	9.07	8.89	8.86	8.86	8.82	9.56						
175	10.2	9.54	9.26	9.28	9.23	9.55	9.53	9.25	9.15	9.14	9.17	9.83						
180	10.2	9.65	9.43	9.42	9.45	10.02	10.2	9.64	9.44	9.42	9.42	9.99						

C Range: 0 - 360DEG
C Interval: 30.0DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:Mr.Ma
Test Date:20 February 2024
γ Range: 0 - 180DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.459
Humidity:65.0%
Test Distance:6.700m [K=1.0000]
Remarks: